

SOUTHERN SAN JOAQUIN MUNICIPAL UTILITY DISTRICT



Kern County, California

NOTICE TO PLANHOLDERS

Addendum 1

**SPECIFICATIONS NO. 26-02
CARATAN RECHARGE PIPELINE**



August 27, 2026

Sign and return this notice with your Proposal.

Firm Name _____
By _____
Title _____
Date _____

By signing the cover sheet, Contractor certifies that it has reviewed the contents of the subject addendum and that its proposal has been prepared taking into consideration the changes made by said addenda.

Addendum 1
SPECIFICATIONS NO. 26-02
CARATAN RECHARGE PIPELINE

Specification No. 26-02 is hereby changed and/or clarified as follows.

1. Specifications – D-21 Special Environmental Requirements, Page D-30, insert

iii. Western Spadefoot

- a. If project activities occur during a time when the action area may support suitable habitat for breeding Western spadefoot (November 1 to March 31), a qualified biologist employed by the District will conduct a survey of all inundated potential Western spadefoot breeding areas within 3 days before construction activities occur within 50 feet of breeding habitat and/or after potential breeding habitat becomes inundated. If any areas are determined to be occupied by Western spadefoot, a 50-foot no-disturbance buffer will be implemented around the occupied breeding habitat, and the buffer boundary will be staked or fenced under the supervision of a qualified biologist. The buffer will be maintained until breeding activities are completed and young have completed metamorphosis and left the basin.

2. Drawings

- a. Revise Section C/C-05 to change the core hole from 54” to 52”. The drawing is reissued.
- b. Revise Detail 7/C-08 to reflect a 52” core hole. The drawing is reissued.
- c. Revise Appendix C District Furnished Items to include the slide gate shop drawing.
- d. Revise callouts for the Diversion Structure New Connection Plan Detail and the Section A/C-06. Added wall thickness dimension on Detail 1/C-06 and elevation callout removed on Section B/C-06. The drawing is reissued.
- e. Revise Detail 2/C-07 to modify the steel plate dimensions per the slide gate shop drawing. The drawing is reissued.
- f. Revise Detail 1/C-08 to modify the steel plate dimensions per the slide gate shop drawing. The drawing is reissued.

3. Pre-bid questions

- a. *Question:* Is there an engineer’s estimate for this project?

Answer: The engineer's estimate is \$1.2 million to \$1.5 million.

b. *Question:* Can I get a copy of the Planholders List?

Answer: Yes. It is provided as part of this Addendum 1.

4. Summary of Questions from Pre-bid Conference

a. *Question:* No written questions were submitted at the pre-bid conference.

5. Attachments

- a. Planholders List
- b. Pre-bid conference sign-in sheets
- c. Appendix C – District Furnished Items, Slide Gate Shop Drawing
- d. Specifications – D-21 Special Environmental Requirements, Page D-30, insert as shown above in this Addendum 1.
- e. Drawings
 - a. C-05
 - b. C-06
 - c. C-07
 - d. C-08

Southern San Joaquin Municipal Utility District
SSJMUD 26-02 – Caratan Recharge Pipeline
Planholders List – Addendum 1

ISSUED TO	CONTACT
OneDrive link	
SSJMUD	
Kern County Builders Exchange	sgeissel@kcbex.com admin@kcbex.com sydney@kcbex.com
Dodge Data and Analytics	support@construction.com projectdata@construction.com jane.walters@construction.com
Construct Connect	maria.delfino@constructconnect.com
Unified Field Services Corp	Timothy Jacober Tim_Jacob@ufsc.us Cherie Layton cherie_layton@ufsc.us
Southern San Joaquin MUD	Connie Andrade conniea@ssjmud.org
Utility Concrete Products, LLC	Alex Poe apoe@utilityconcrete.com
Granite Construction Company	Sarah.Pearse@gcinc.com
Specialty Construction Inc.	Tom Seidel bids@specialtyconstruction.com SHERI SHAMBLIN
NovaTech	Sandy Jenkins (she/her) sjenkins@novatechnologiesgrp.com
Superior Ag Construction	Nathan Delk ndelk@macgeneralengineering.com
HPS Mechanical	Alyssa Ortiz AOrtiz@hpsmechanical.com
Whitaker Construction Group	Randy Walters rwalters@wcgroupinc.com
S&B Sons	Alan Bednersh projects@sbsonsus.com
Rain for Rent	Rob Morgan fwmorgan@rainforrent.com

Southern San Joaquin Municipal Utility District
SSJMUD 26-02 – Caratan Recharge Pipeline
Planholders List – Addendum 1

ISSUED TO	CONTACT
West Valley Construction	Sean Morgan smorgan@wvcc.com



SOUTHERN SAN JOAQUIN MUNICIPAL UTILITY DISTRICT

SPECIFICATIONS NO. SSMUD 26-02
CARATAN RECHARGE PIPELINE

Pre-Bid Conference Attendance

Name	Company	Email Address	Phone
Alan Bednersh	S & B sons	projects@sbsonsvs.com	661-541-5191
Rob Morgan	Rain For Rent	rmorgan@rainforrent.com	559-352-2089
Sam Schaefer	GEI Consultants	sschaefer@geiconsultants.com	803-729-4677
Ethan Hunter	GEI CONSULTANTS	ehunter@geiconsultants.com	661-809-5909
Sean Morgan	West Valley Construction	smorgan@wvcc.com	661-671-2260
Luis Flores	SSJMUD		661-444-9558
Fabian Acuna	GEI CONSULTANTS	facuna@geiconsultants.com	661-375-0114




SOUTHERN SAN JOAQUIN MUNICIPAL UTILITY DISTRICT

SPECIFICATIONS NO. SSMUD 26-02
CARATAN RECHARGE PIPELINE

Pre-Bid Conference Attendance

Name	Company	Email Address	Phone
Branden Bailey	Superior Ag Construction	branden@superioragconstruction.com	(559) 792-2297

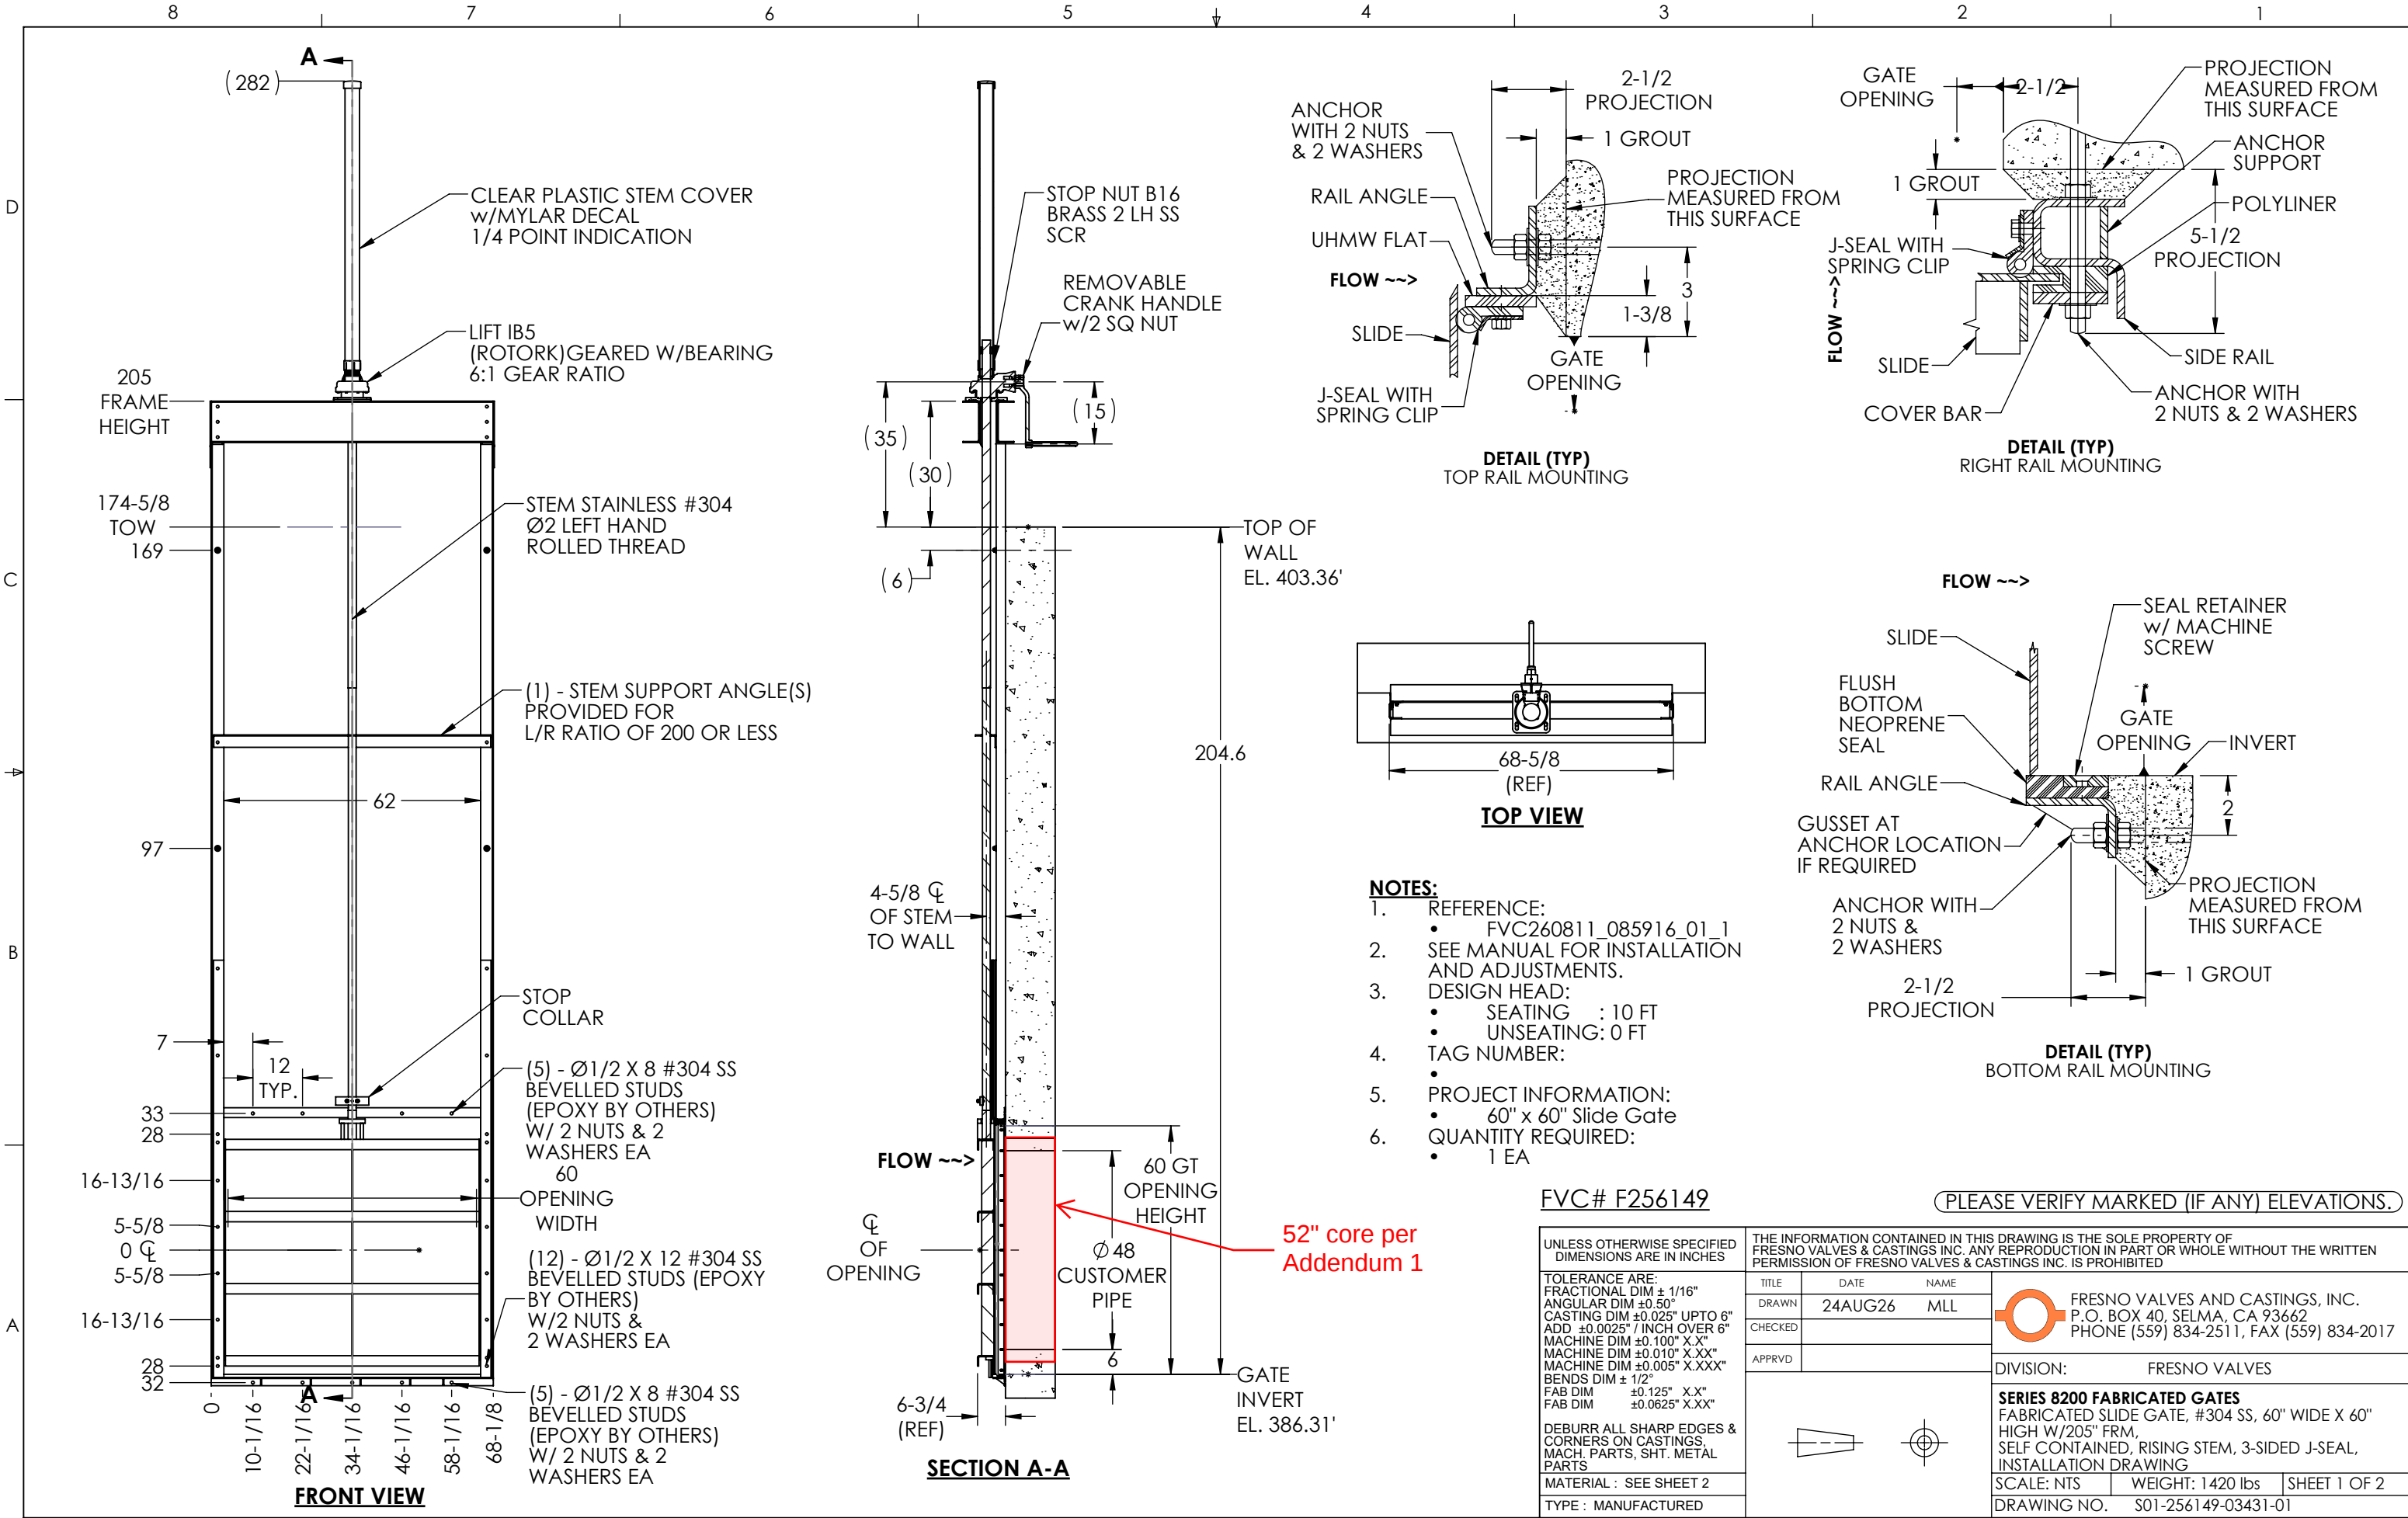




FVC# F256149


REFERENCE: FVC260811_085916_01_1

8 7 6
\\FILESERV1\SolidworksFiles.map\Solidworks\0000 Series Orders\S01-256149-03431-01\S01-256149-03431-01.slddrw


ACUNA, FABIAN, ENVIRON SOUTHERN SAN JOAQUIN MUNICIPAL UTILITY DISTRICT 2303615 SSJMUD Caratan Spreading Facility/00_CAD/Design/Sheets/Piping/1_18_2025/D-01 DEMOLITION PLAN.dwg - 8/27/2026

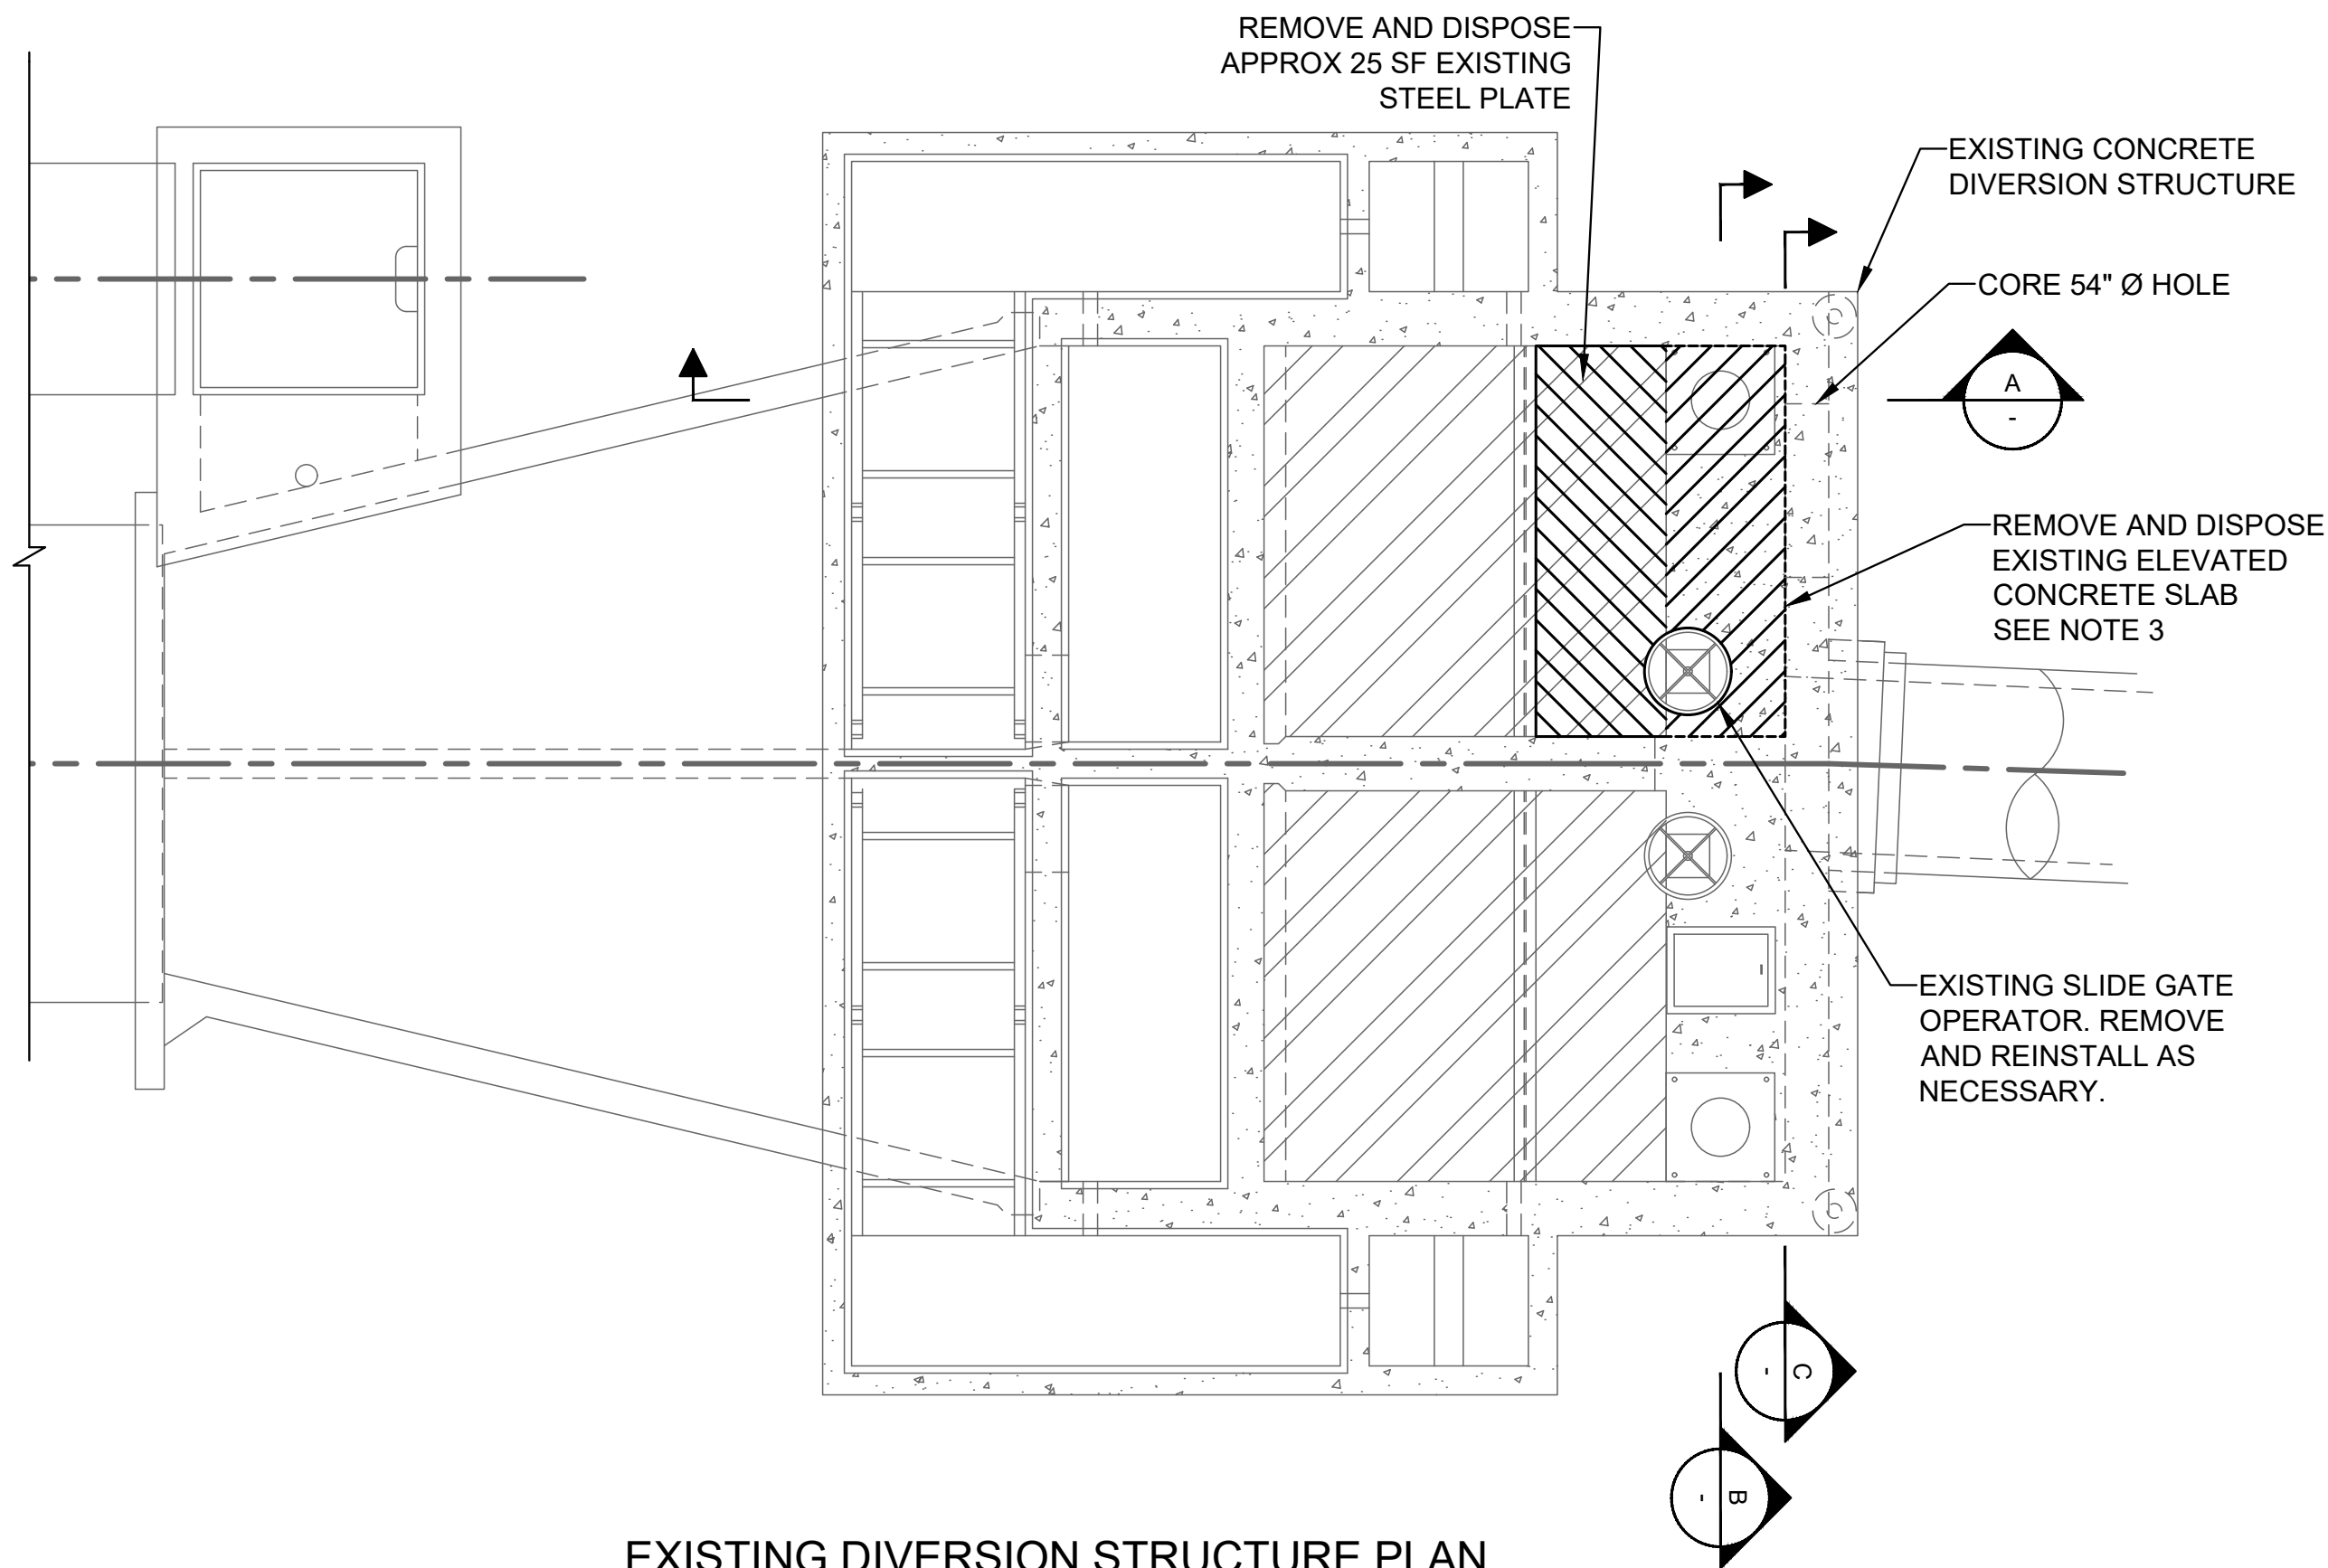


EXISTING DIVERSION STRUCTURE PLAN
SCALE: 1" = 4'

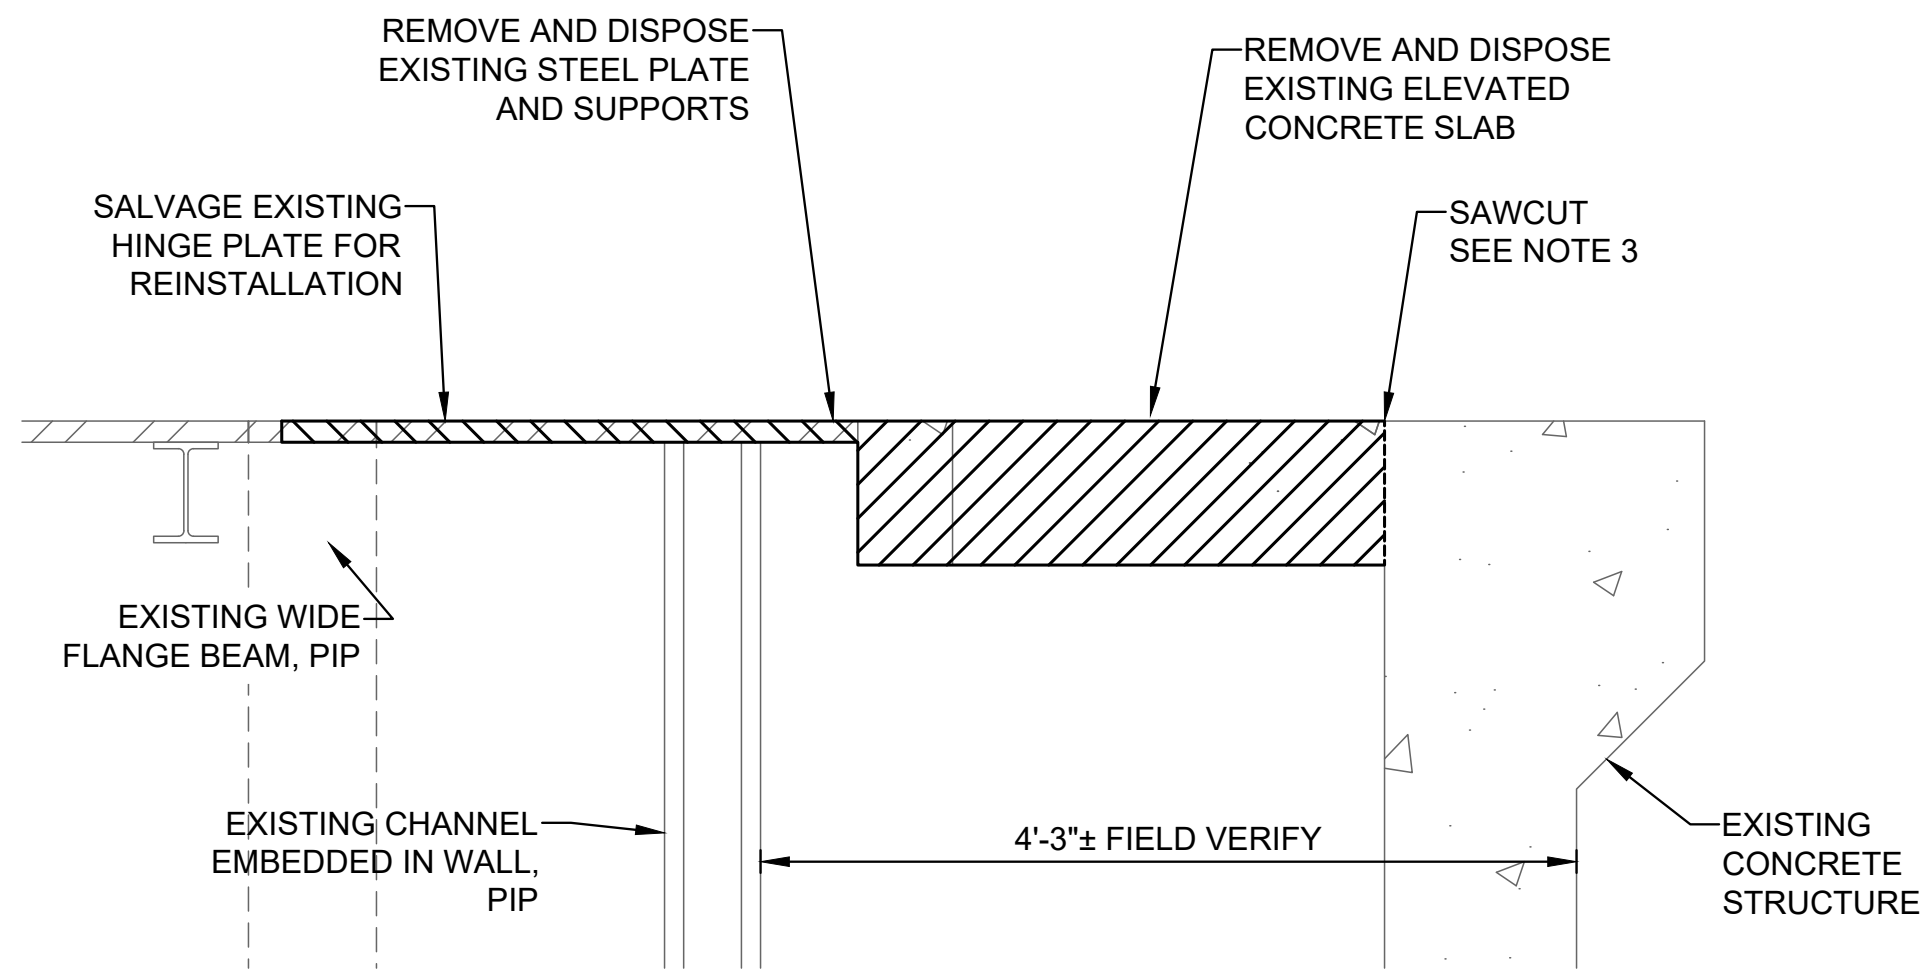


1
-
DETAIL
CONCRETE SLAB AND STEEL PLATE DEMO
SCALE: 1" = 1'

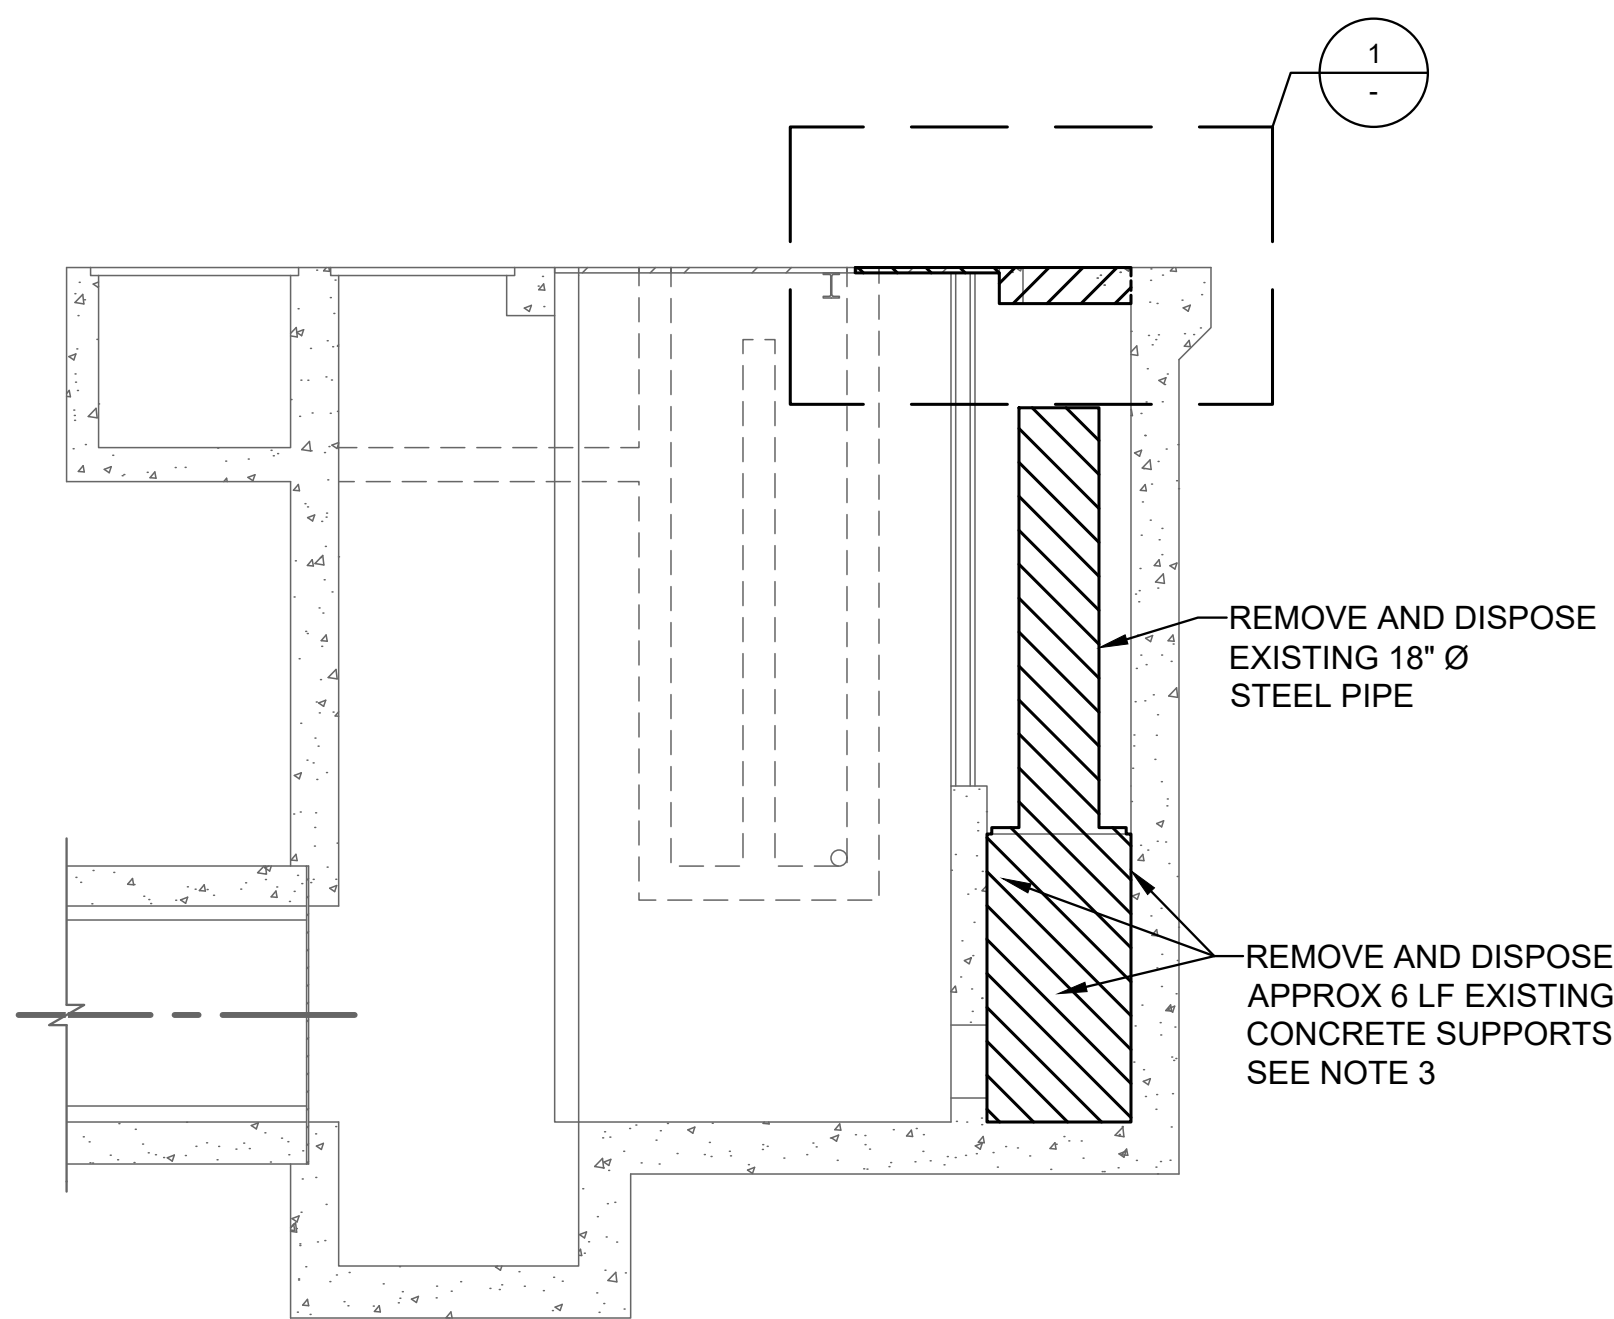

A
-
SECTION
EXISTING DIVERSION STRUCTURE SECTION
SCALE: 1" = 4'

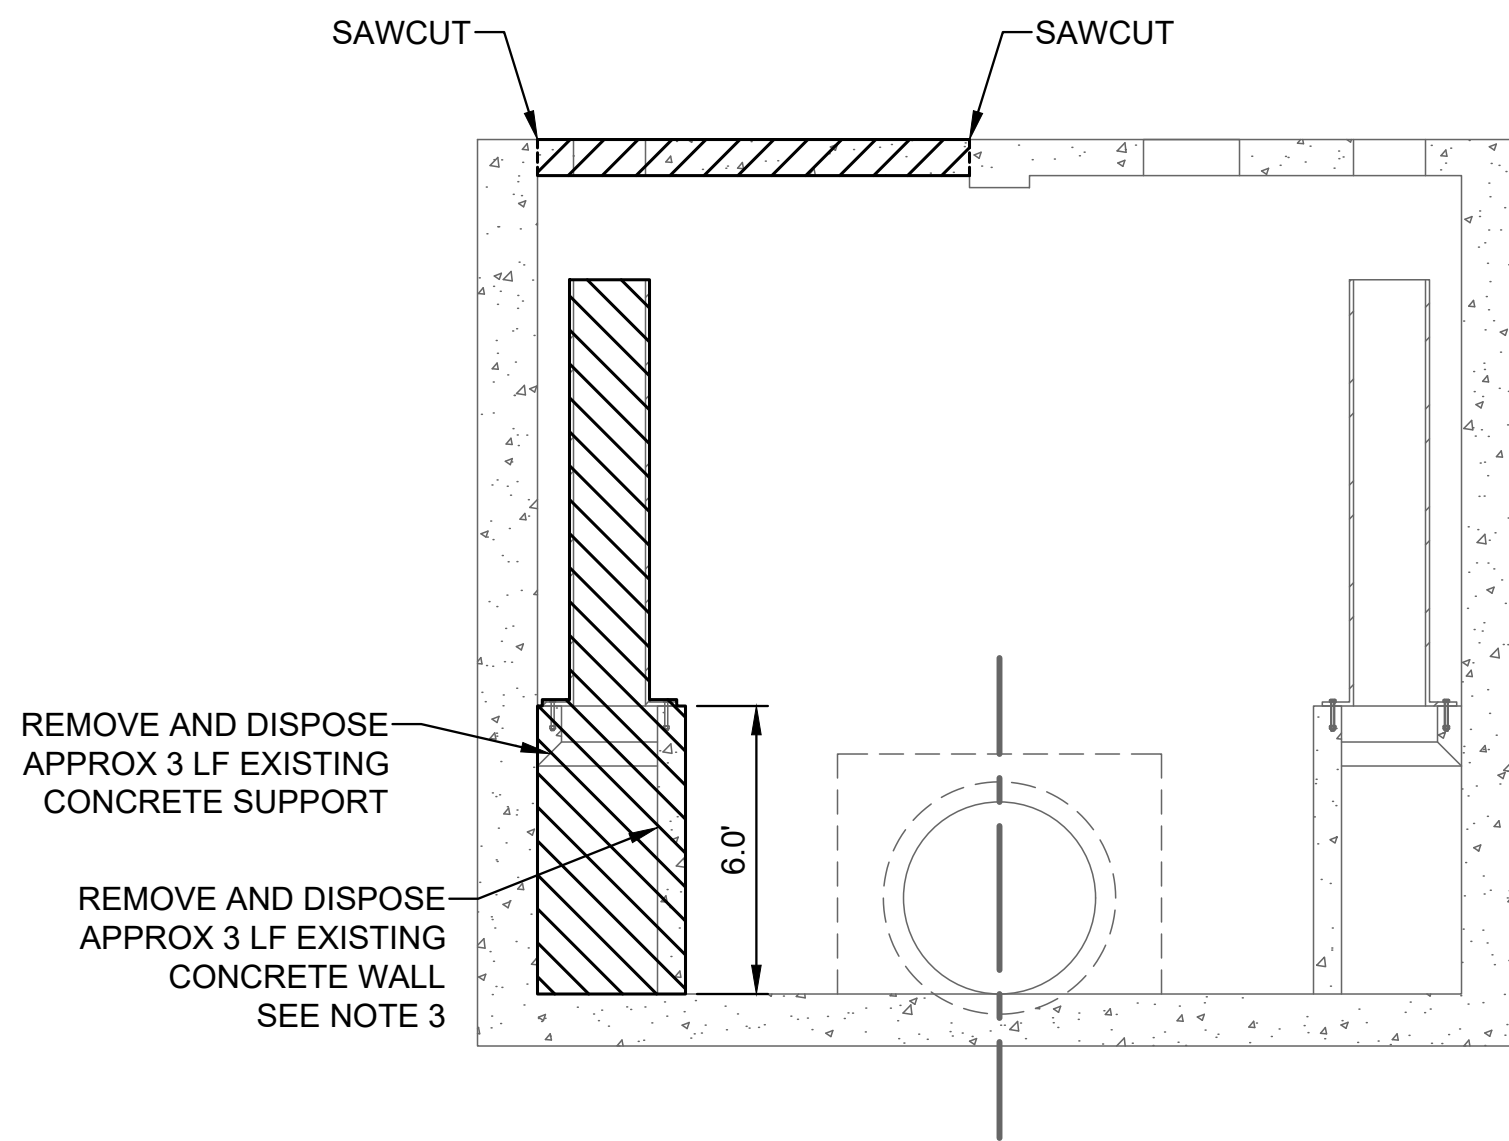

B
-
SECTION
EXISTING DIVERSION STRUCTURE SECTION
SCALE: 1" = 4'

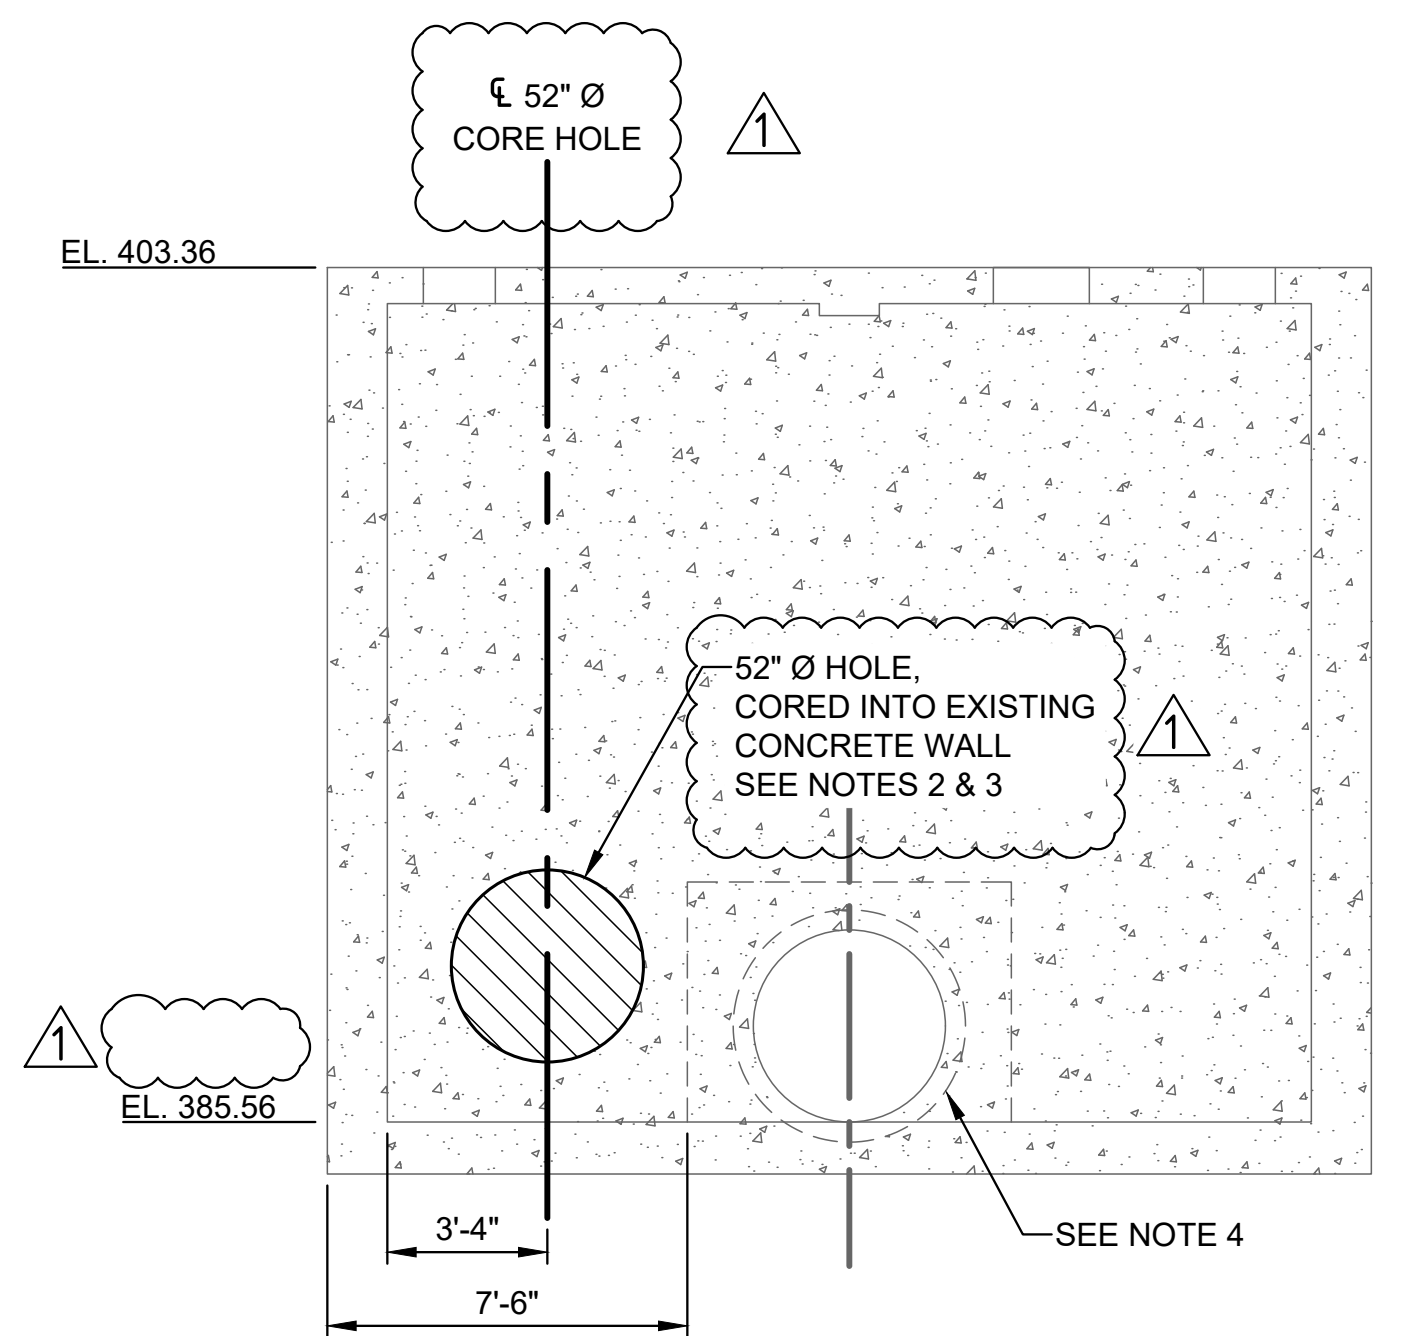

C
-
SECTION
CORE LAYOUT
SCALE: <<Insert field to viewport>>

- DIMENSIONS SHOWN OF EXISTING STRUCTURE ARE APPROXIMATE. THE CONTRACTOR SHALL CONFIRM THE EXISTING DIMENSIONS.
- VERIFY LOCATION OF HOLE WITH ENGINEER PRIOR TO CORING THE HOLE.
- COAT EXPOSED REBAR AFTER SAW CUTTING WITH EPOXY.
- PROTECT STRUCTURAL INTEGRITY OF WALL.

Attention:
0 1"
If this scale bar does not measure 1" then drawing is not original scale.



Designed: S. SCHAEFER
Drawn: F. ACUNA
Checked: M. MARTIN
Approved: S. SCHAEFER
P.E. No: 35079
GEI Project 2303615



SOUTHERN SAN JOAQUIN
MUNICIPAL UTILITY DISTRICT
11281 GARZOLI AVE
DELANO, CA 93215

GEI PROJECT 2303615

SSJMUD 26-02 CARATAN RECHARGE PIPELINE




1	8/27/2026	ADDENDUM 1	MM
NO	DATE	ISSUE/REVISION	APP

SHEET NAME
**DIVERSION STRUCTURE
DEMOLITION PLAN**


DWG NO.
C-05
SHEET. NO.
9 OF 17

IFB


ACUNA, FABIAN - Working/SOUTHERN SAN JOAQUIN MUNICIPAL UTILITY DISTRICT/2303615 SSJMUD Caratan Recharge Pipeline/1_18_2025/DIVERSION STRUCTURE MODIFICATIONS AND DETAILS 1 OF 3.dwg - 8/27/2026

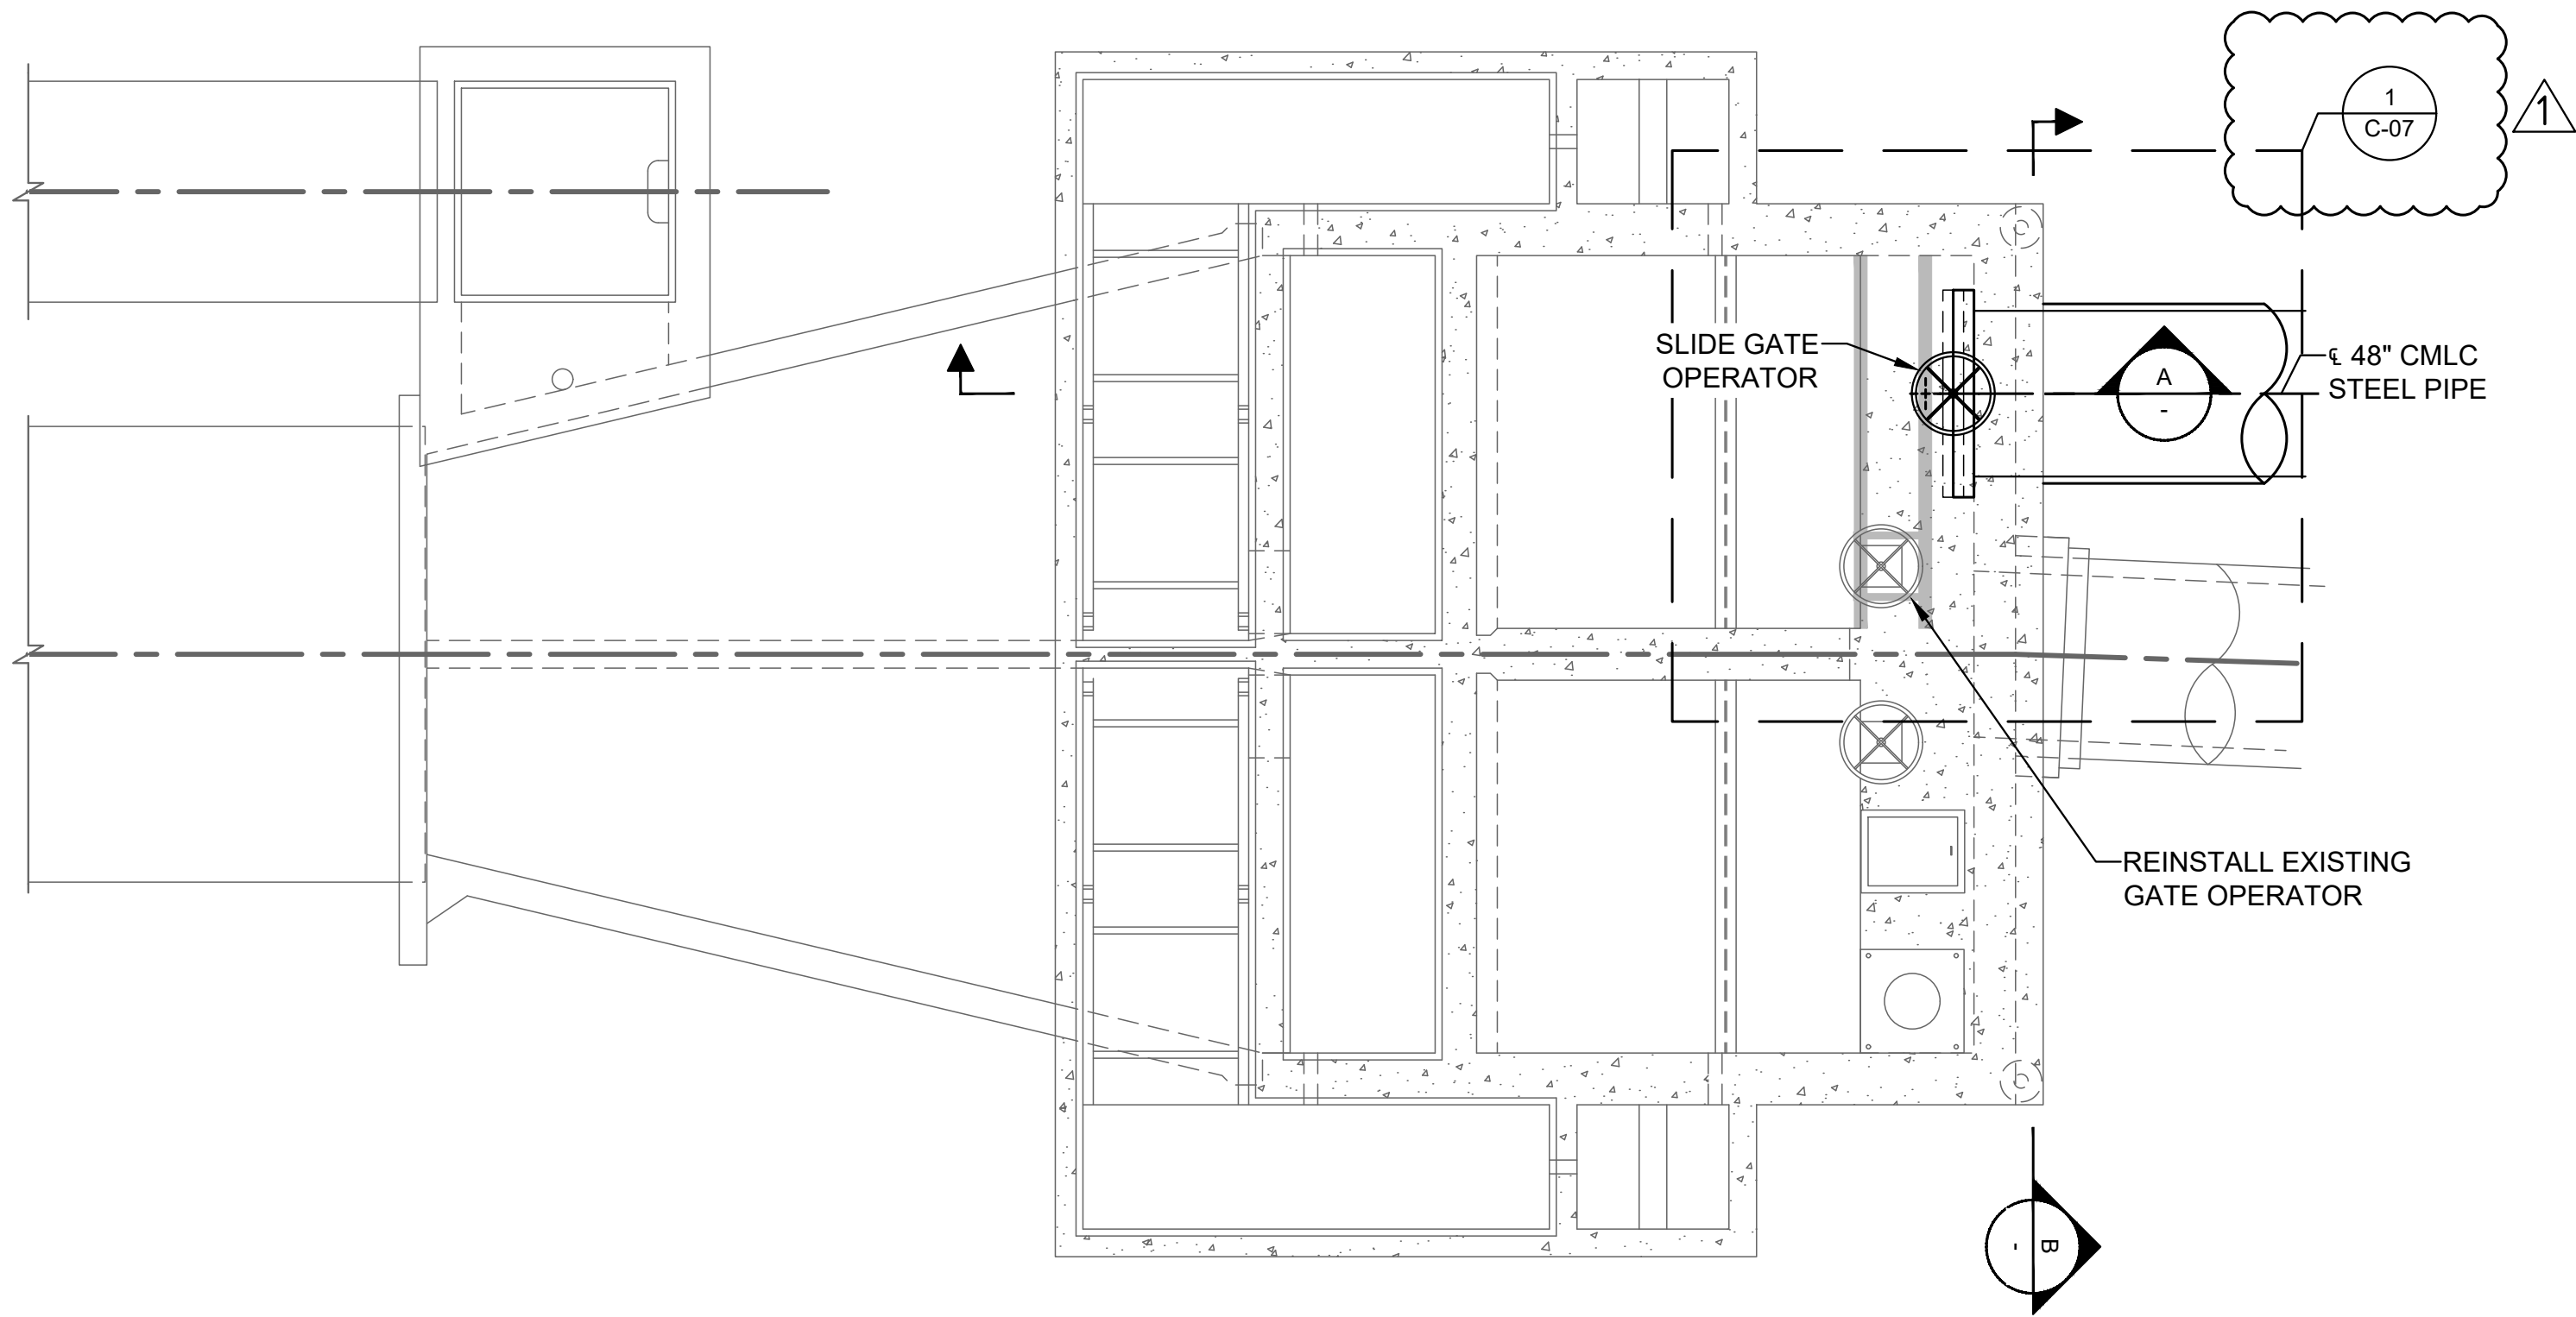


DIVERSION STRUCTURE NEW CONNECTION PLAN
SCALE: 1" = 4'

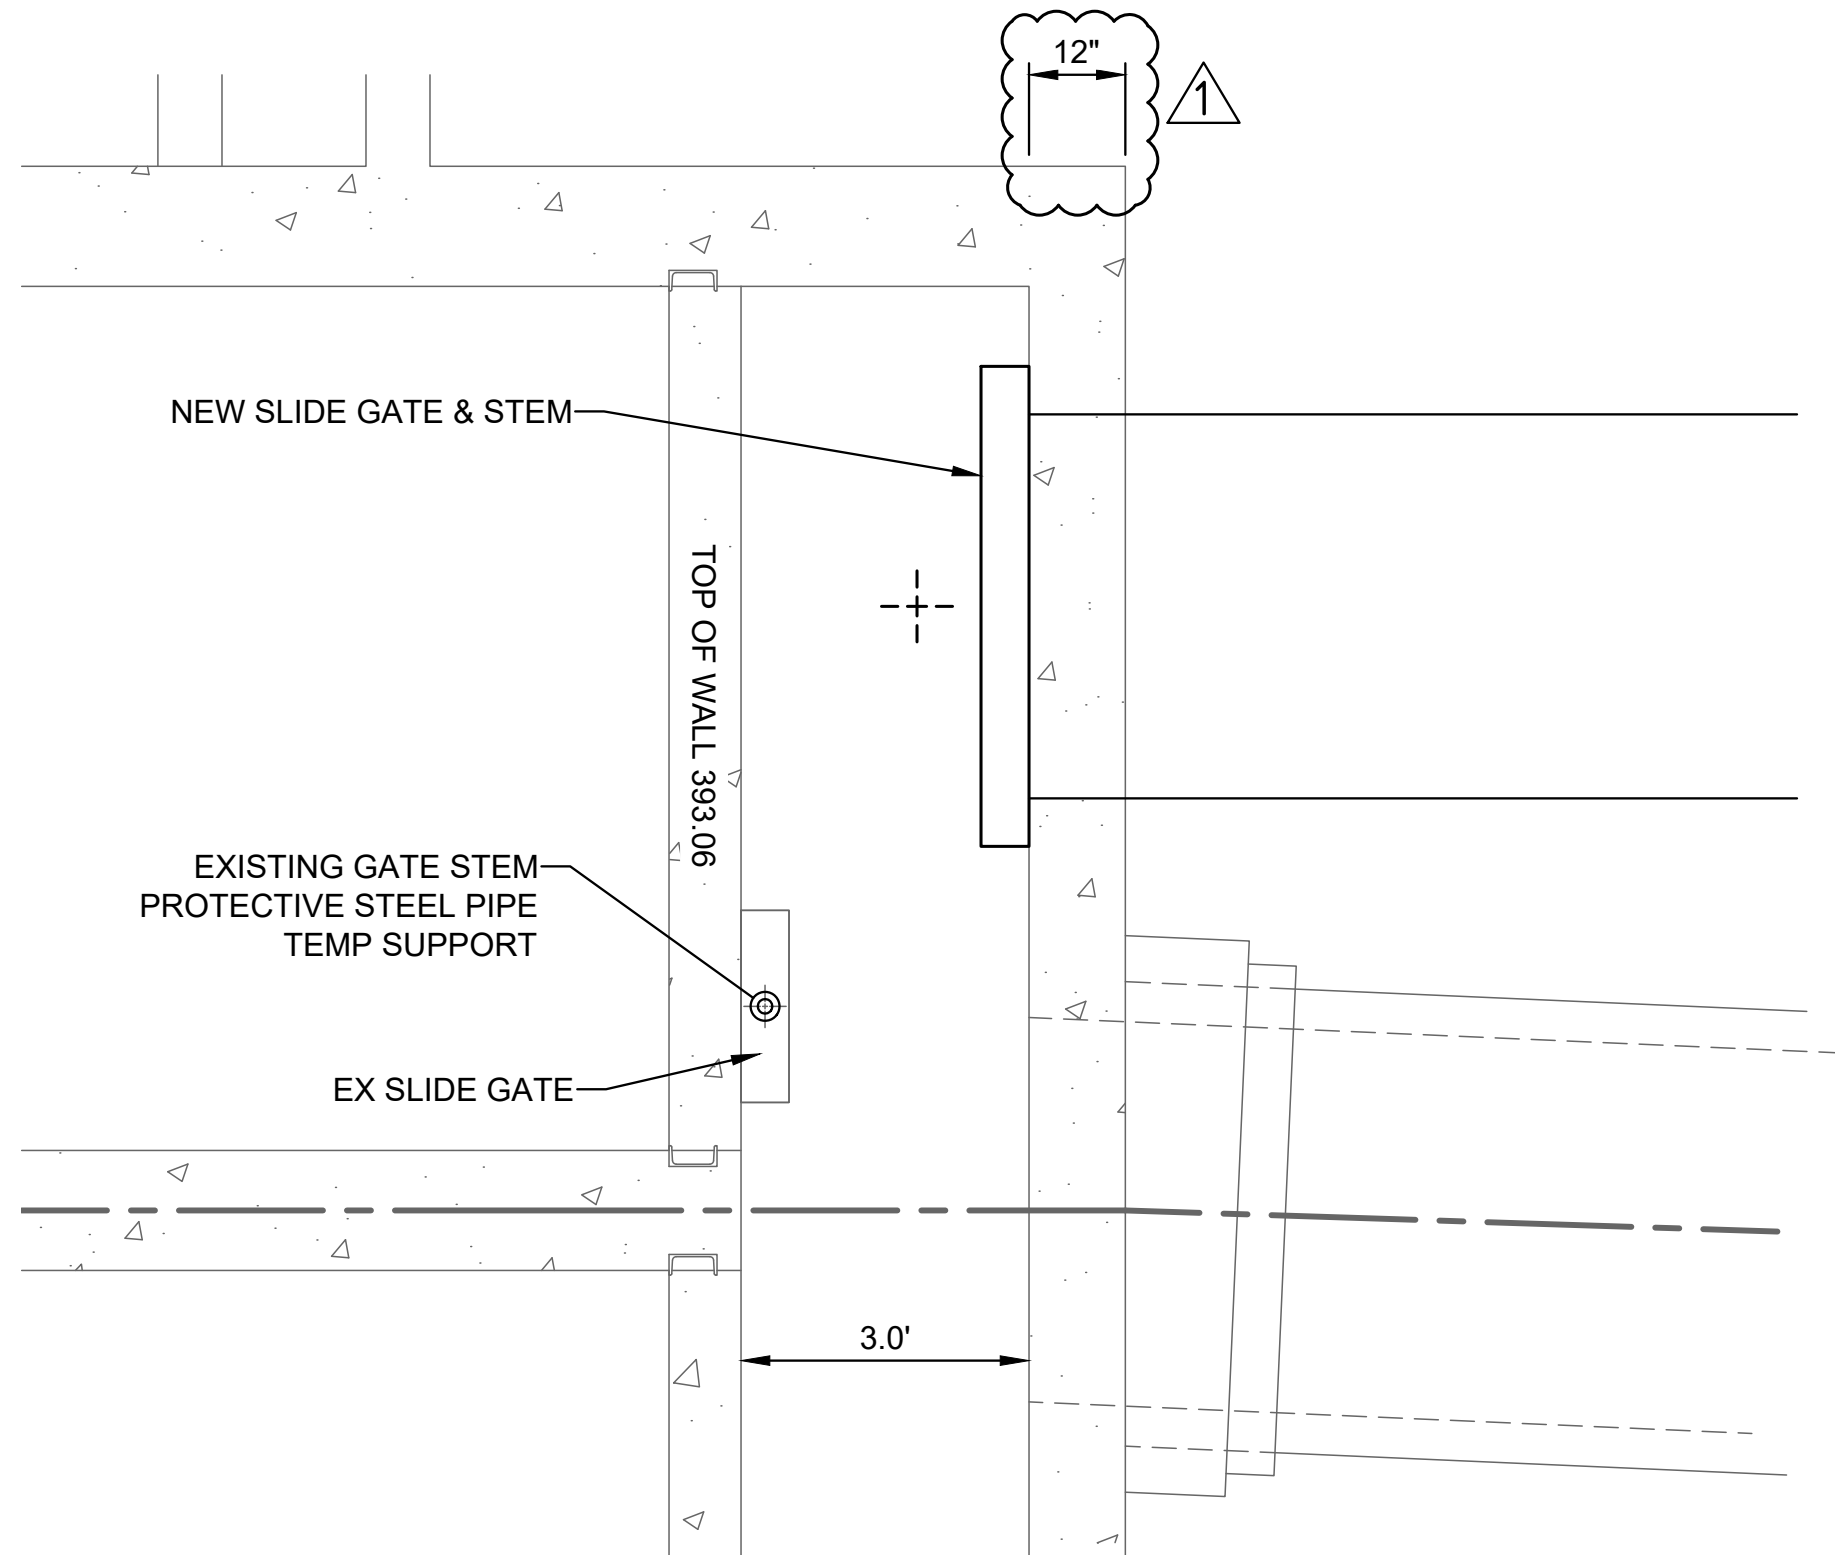

1 PLAN AT EL. 397.0
NO SCALE

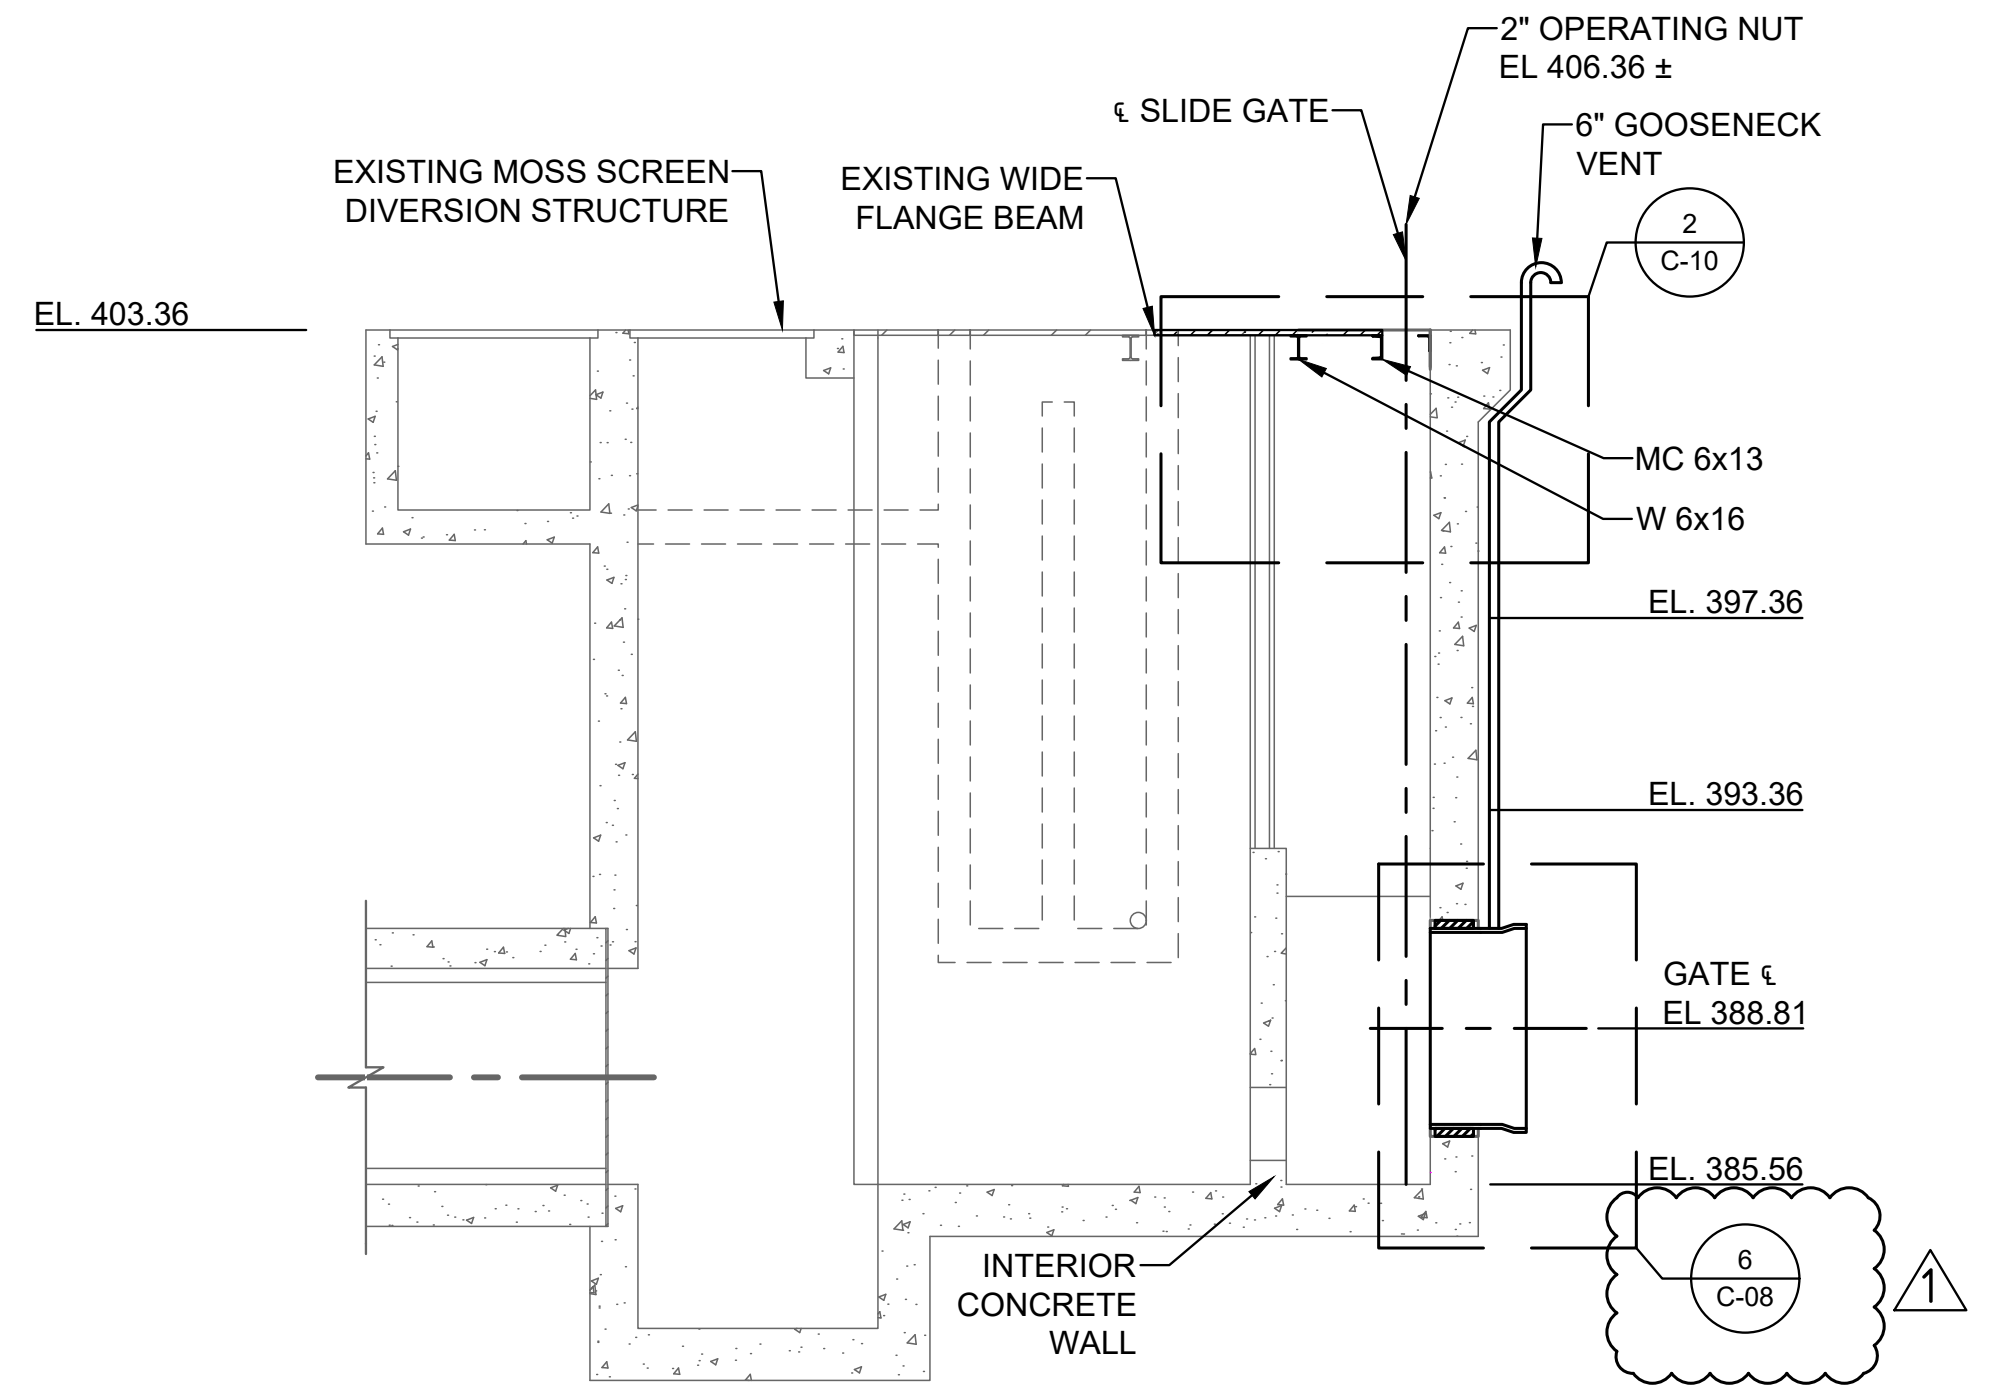

A SECTION
PROFILE THROUGH DIVERSION STRUCTURE
SCALE: 1" = 4'

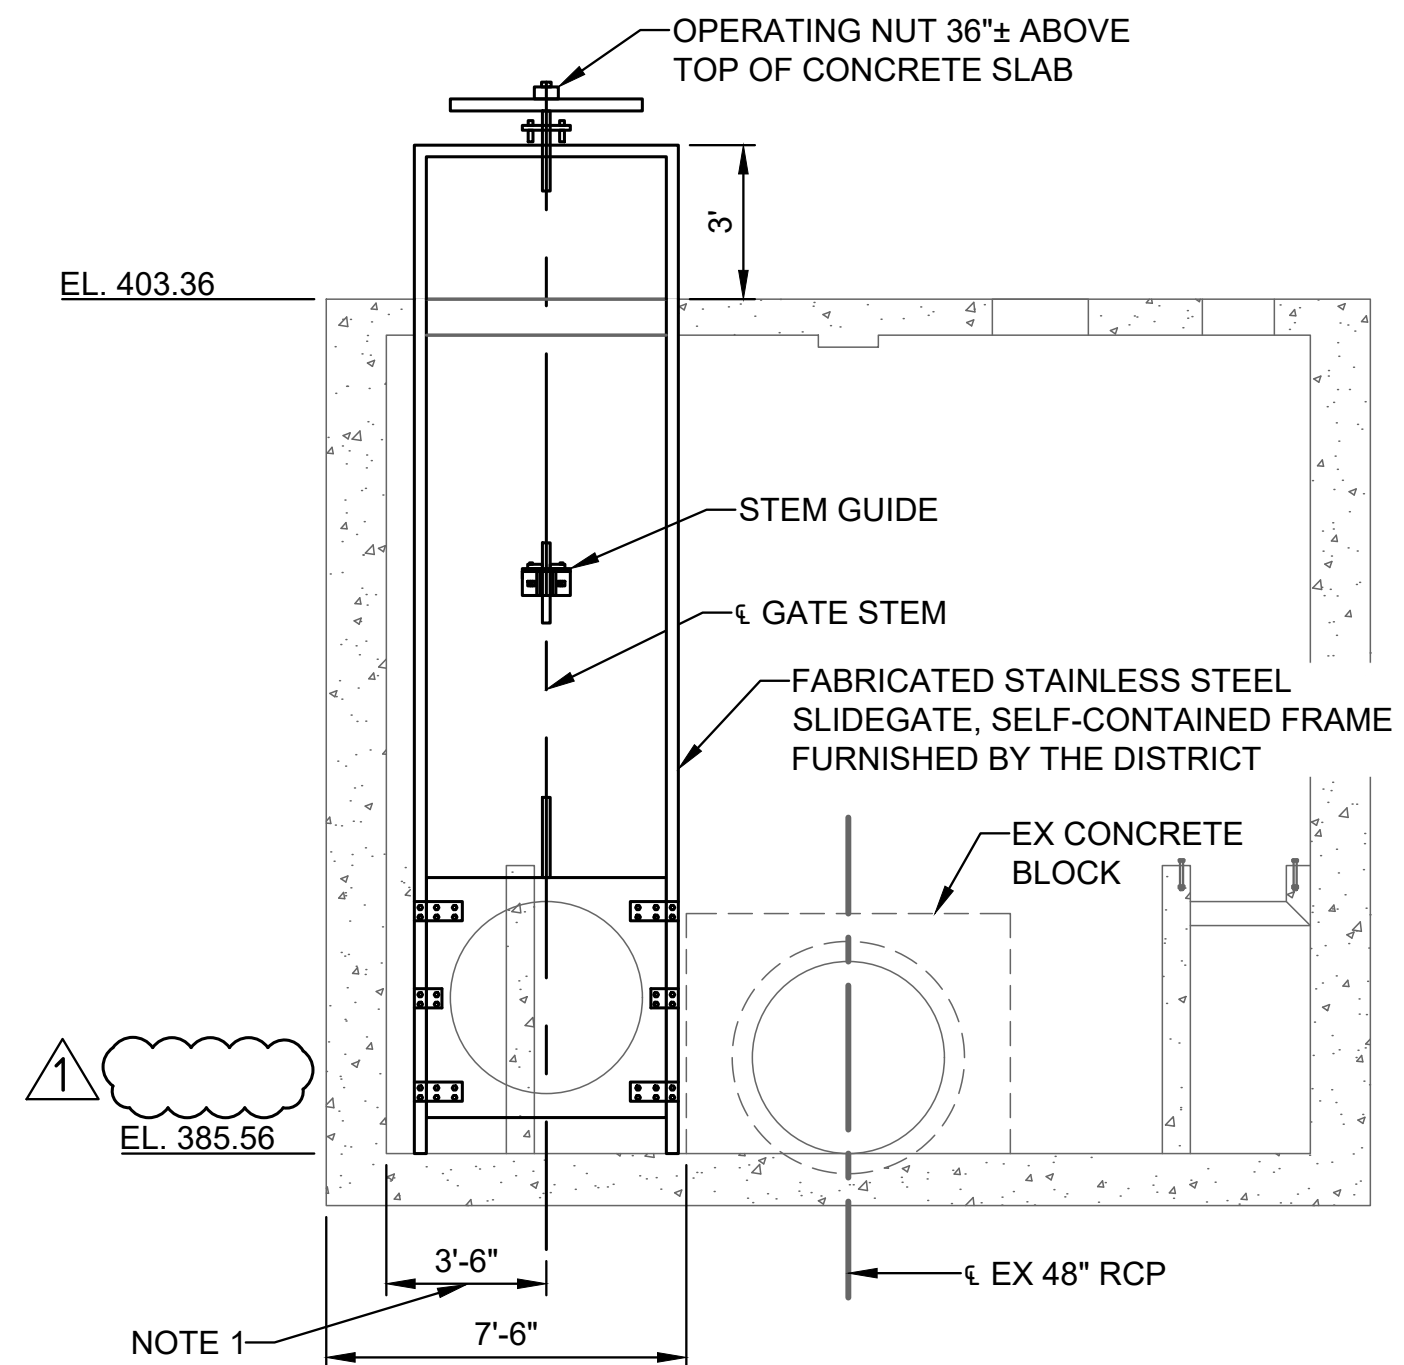

B SECTION
SLIDE GATE
NO SCALE

Attention:
0 1"
If this scale bar does not measure 1" then drawing is not original scale.



Designed: S. SCHAEFER
Drawn: F. ACUNA
Checked: M. MARTIN
Approved: S. SCHAEFER
P.E. No: 35079
GEI Project 2303615



SOUTHERN SAN JOAQUIN
MUNICIPAL UTILITY DISTRICT
11281 GARZOLI AVE
DELANO, CA 93215

GEI PROJECT 2303615

SSJMUD 26-02 CARATAN RECHARGE PIPELINE



1	8/27/2026	ADDENDUM 1	MM
NO	DATE	ISSUE/REVISION	APP

SHEET NAME
**DIVERSION STRUCTURE
MODIFICATIONS AND
DETAILS 1 OF 3**

DWG NO.



C-06

SHEET. NO.


10 OF 17

IFB

ACUNA, FABIAN - E:\Working\SOUTHERN SAN JOAQUIN MUNICIPAL UTILITY DIST\2303615 SSJMUD Caratan Spreading Facility\00_CAD\Design\Sheets\Piping\1_18_2025\DIVERSION STRUCTURE MODIFICATIONS AND DETAILS 2 OF 3.dwg - 8/27/2026

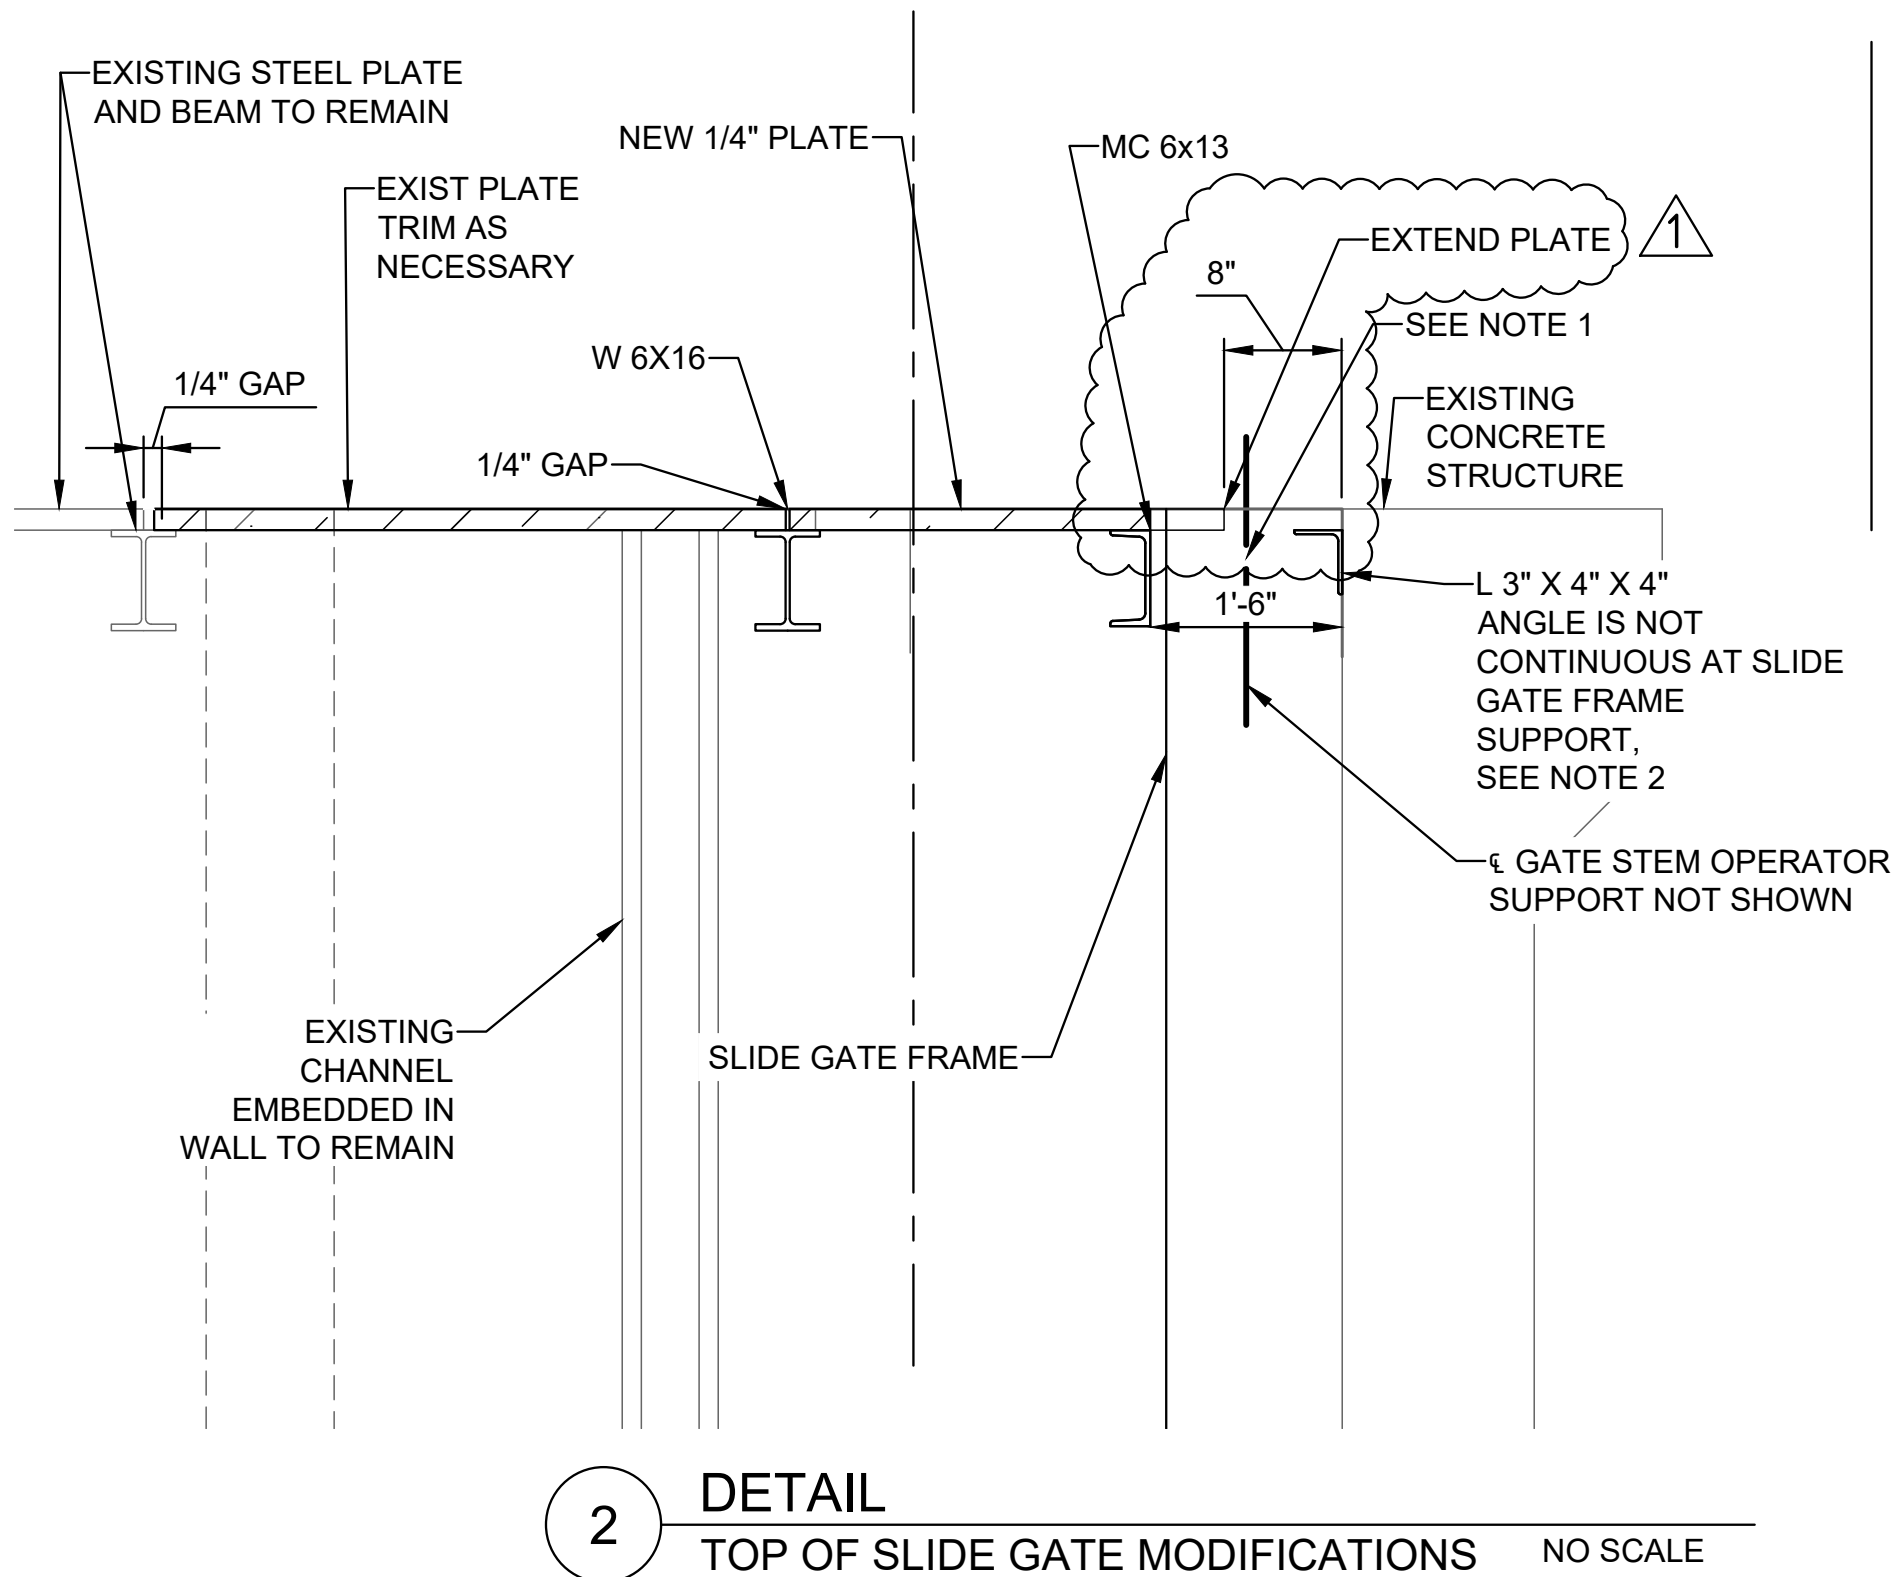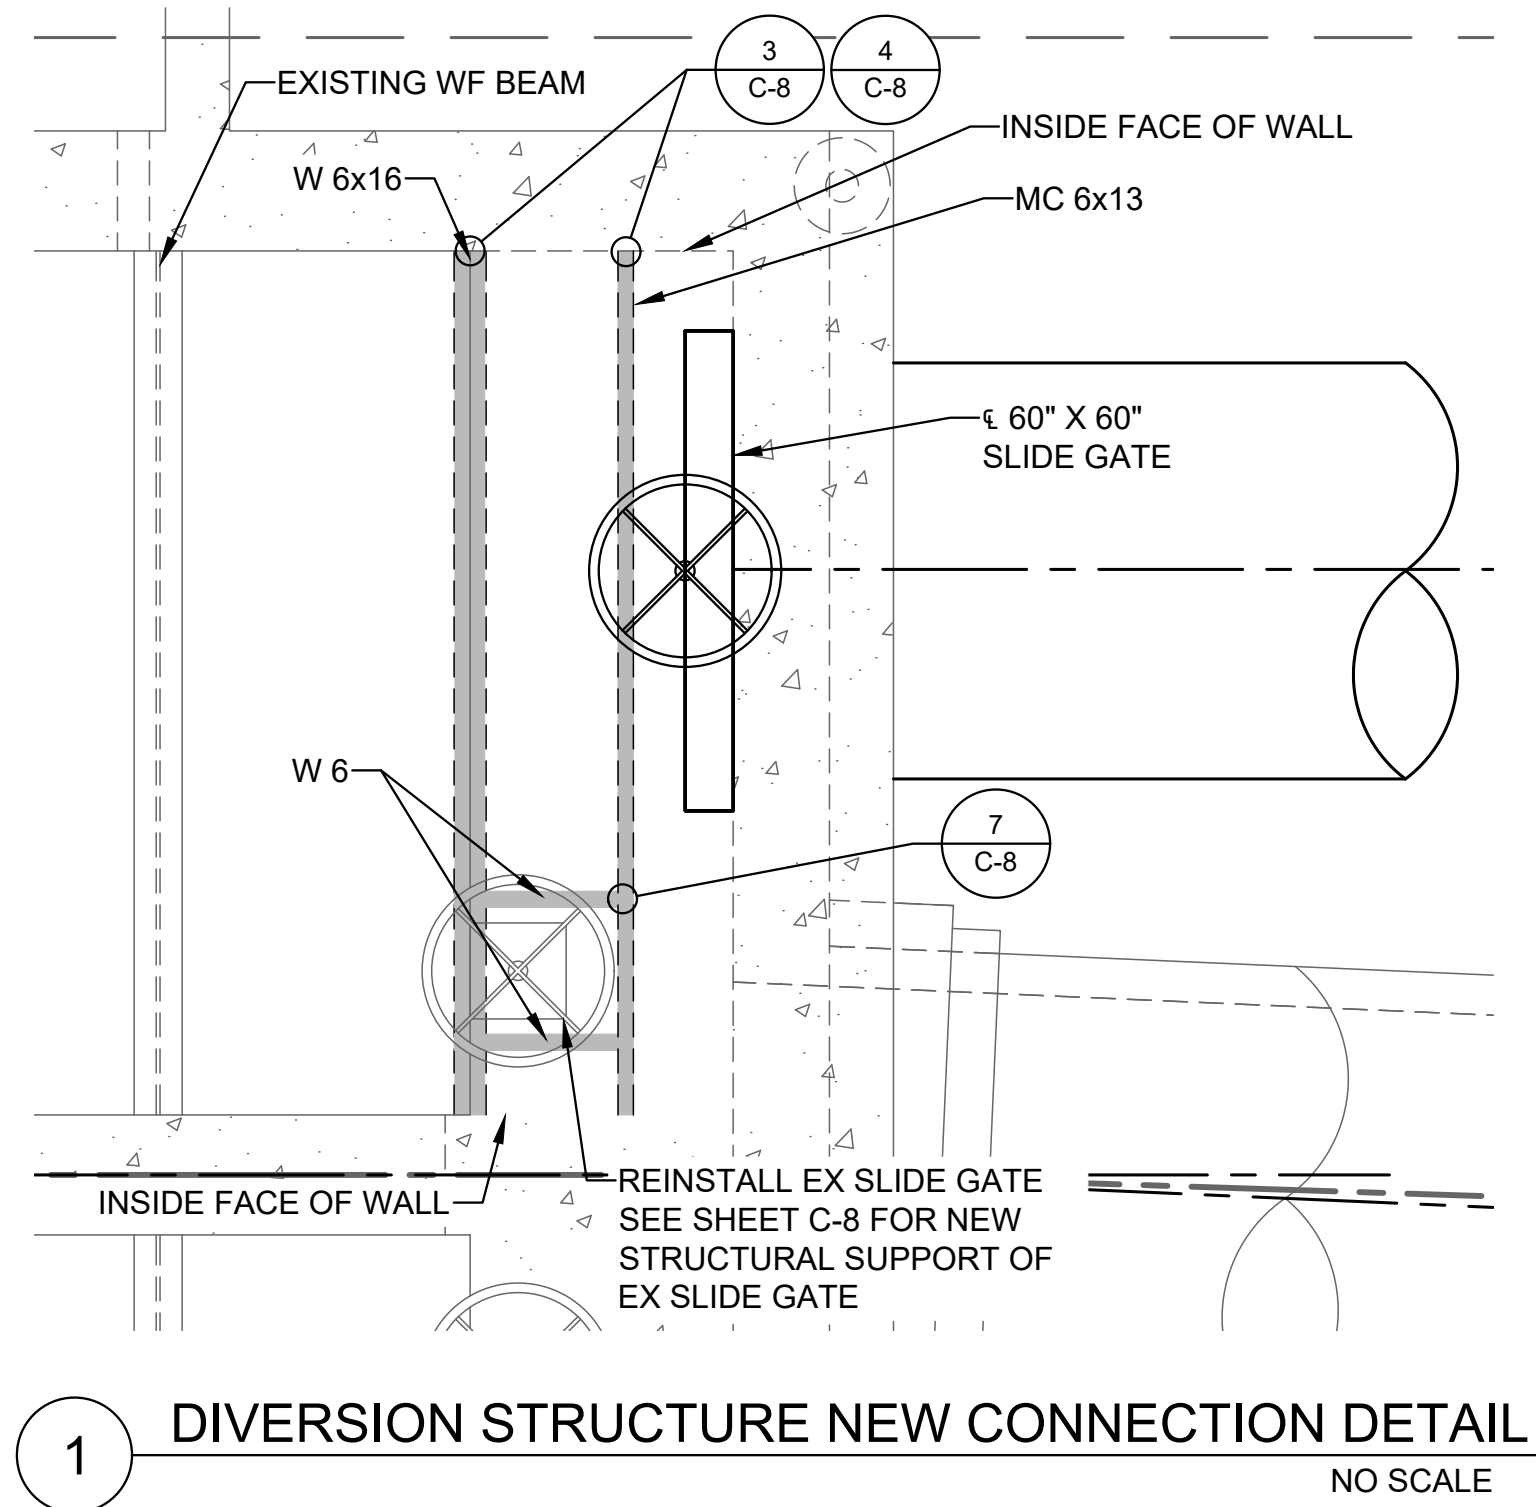

1. VERIFY GATE FRAME WILL CLEAR WALL AND THREADED ANCHORS ARE INSTALLED WHEN REMOVING THE GATE.
2. ATTACH L ANGLE TO EXISTING CONCRETE WALL WITH 5/8" x 6" SS ANCHORS AT 4FT MAX SPACING. MINIMUM OF 2 REQUIRED PER ANGLE SUPPORT. ANCHOR LOCATION SHALL NOT BE GREATER THAN 6" FROM END OF ANGLE.

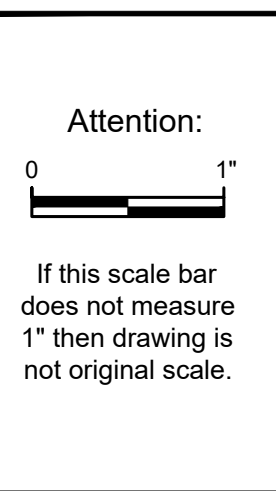

Designed:	S. SCHAEFER
Drawn:	F. ACUNA
Checked:	M. MARTIN
Approved:	S. SCHAEFER
P.E. No:	35079
GEI Project	2303615



SOUTHERN SAN JOAQUIN
MUNICIPAL UTILITY DISTRICT
11281 GARZOLI AVE
DELANO, CA 93215

GEI PROJECT 2303615

SSJMUD 26-02 CARATAN RECHARGE PIPELINE




1	8/27/2026	ADDENDUM 1	MM
NO	DATE	ISSUE/REVISION	APP

SHEET NAME
DIVERSION STRUCTURE MODIFICATIONS AND DETAILS 2 OF 3


DWG NO.
C-07
SHEET. NO.
11 OF 17

IFB



ACUNA, FABIAN - B:\Working\SOUTHERN SAN JOAQUIN MUNICIPAL UTILITY DIST\2303615 SSJMUD Caratan Spreading Facility\00_CAD\Design\Sheets\Piping\1_18_2025\DIVERSION STRUCTURE MODIFICATIONS AND DETAILS 3 OF 3.dwg - 8/27/2026

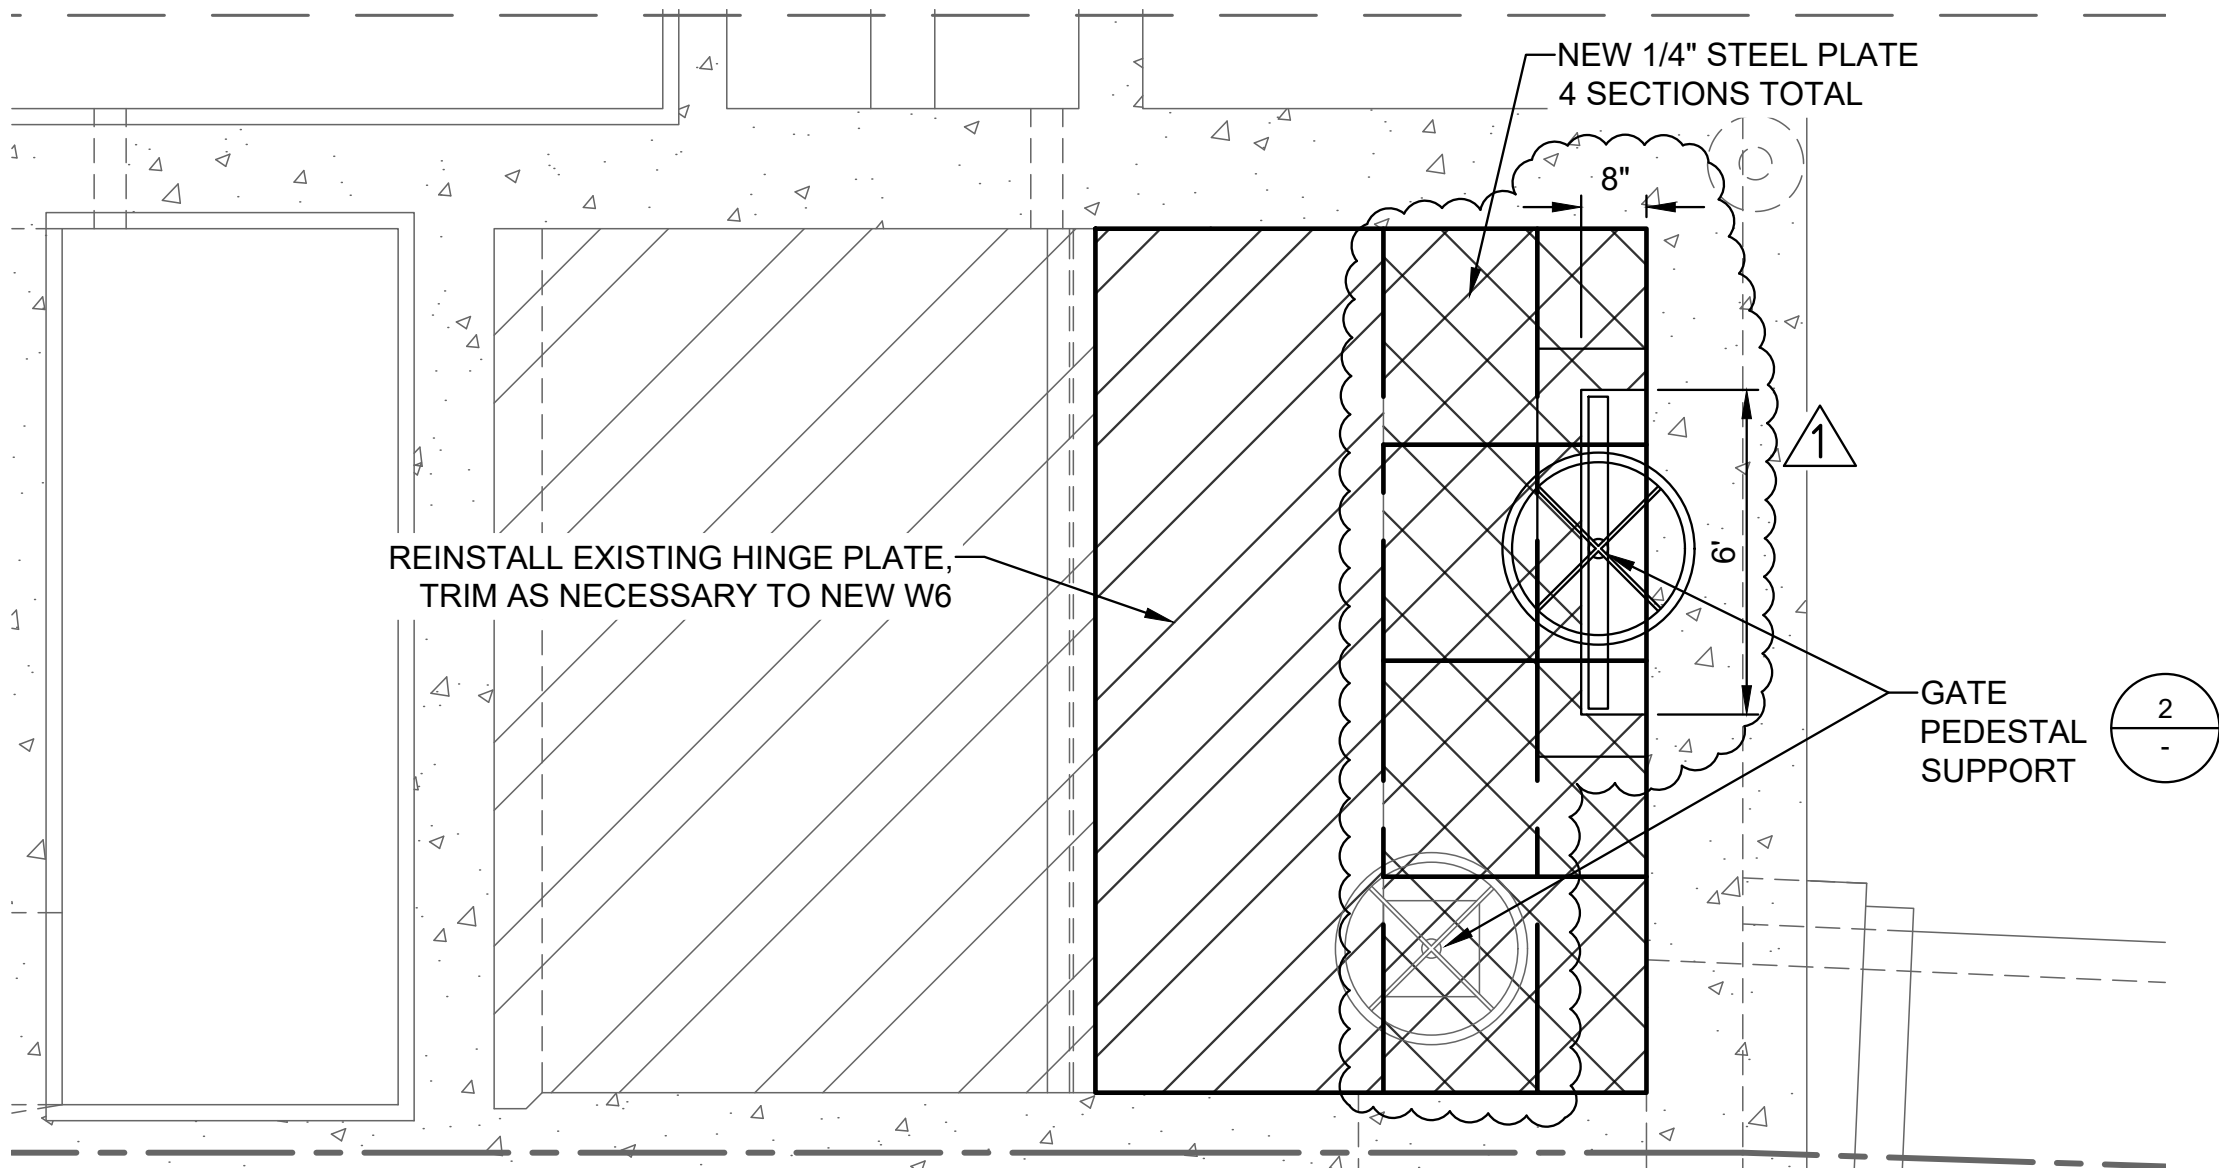


1 DETAIL
STEEL PLATE LAYOUT NO SCALE

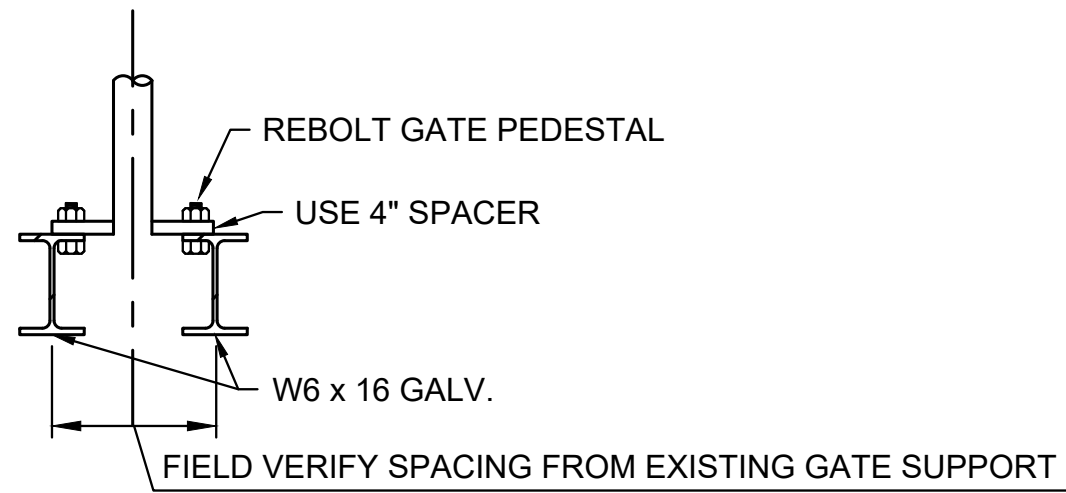


2 DETAIL
GATE PEDESTAL SUPPORT NO SCALE

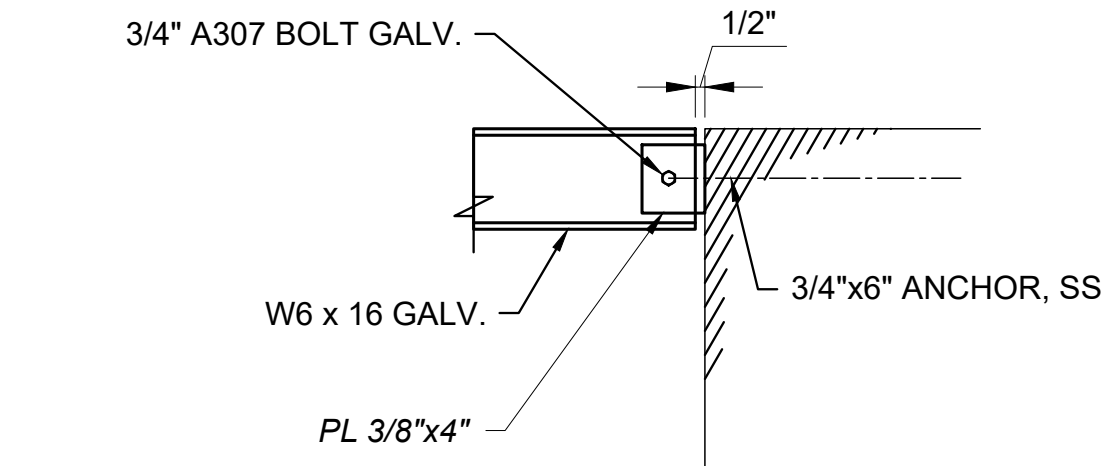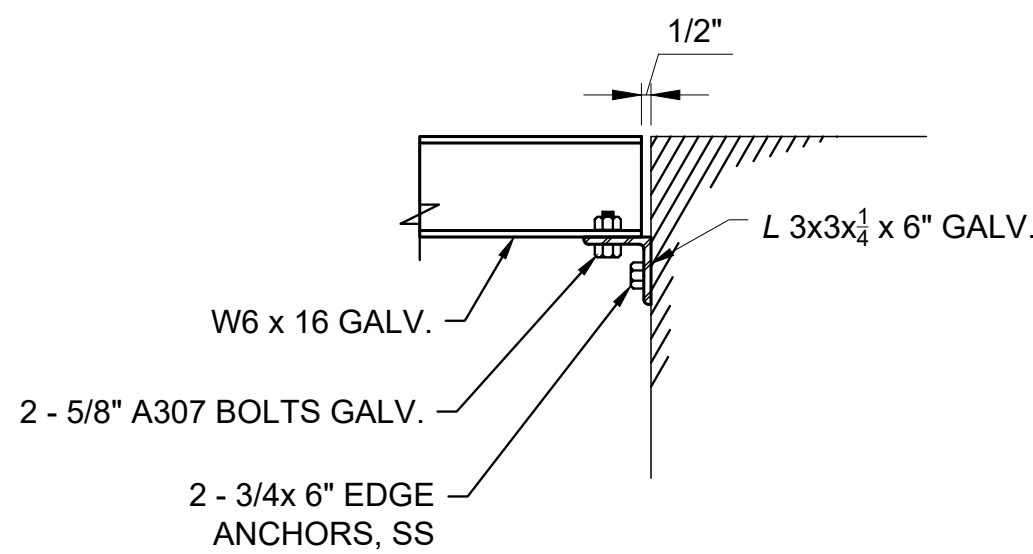


4 DETAIL
ALTERNATIVE I BEAM WALL CONNECTION NO SCALE

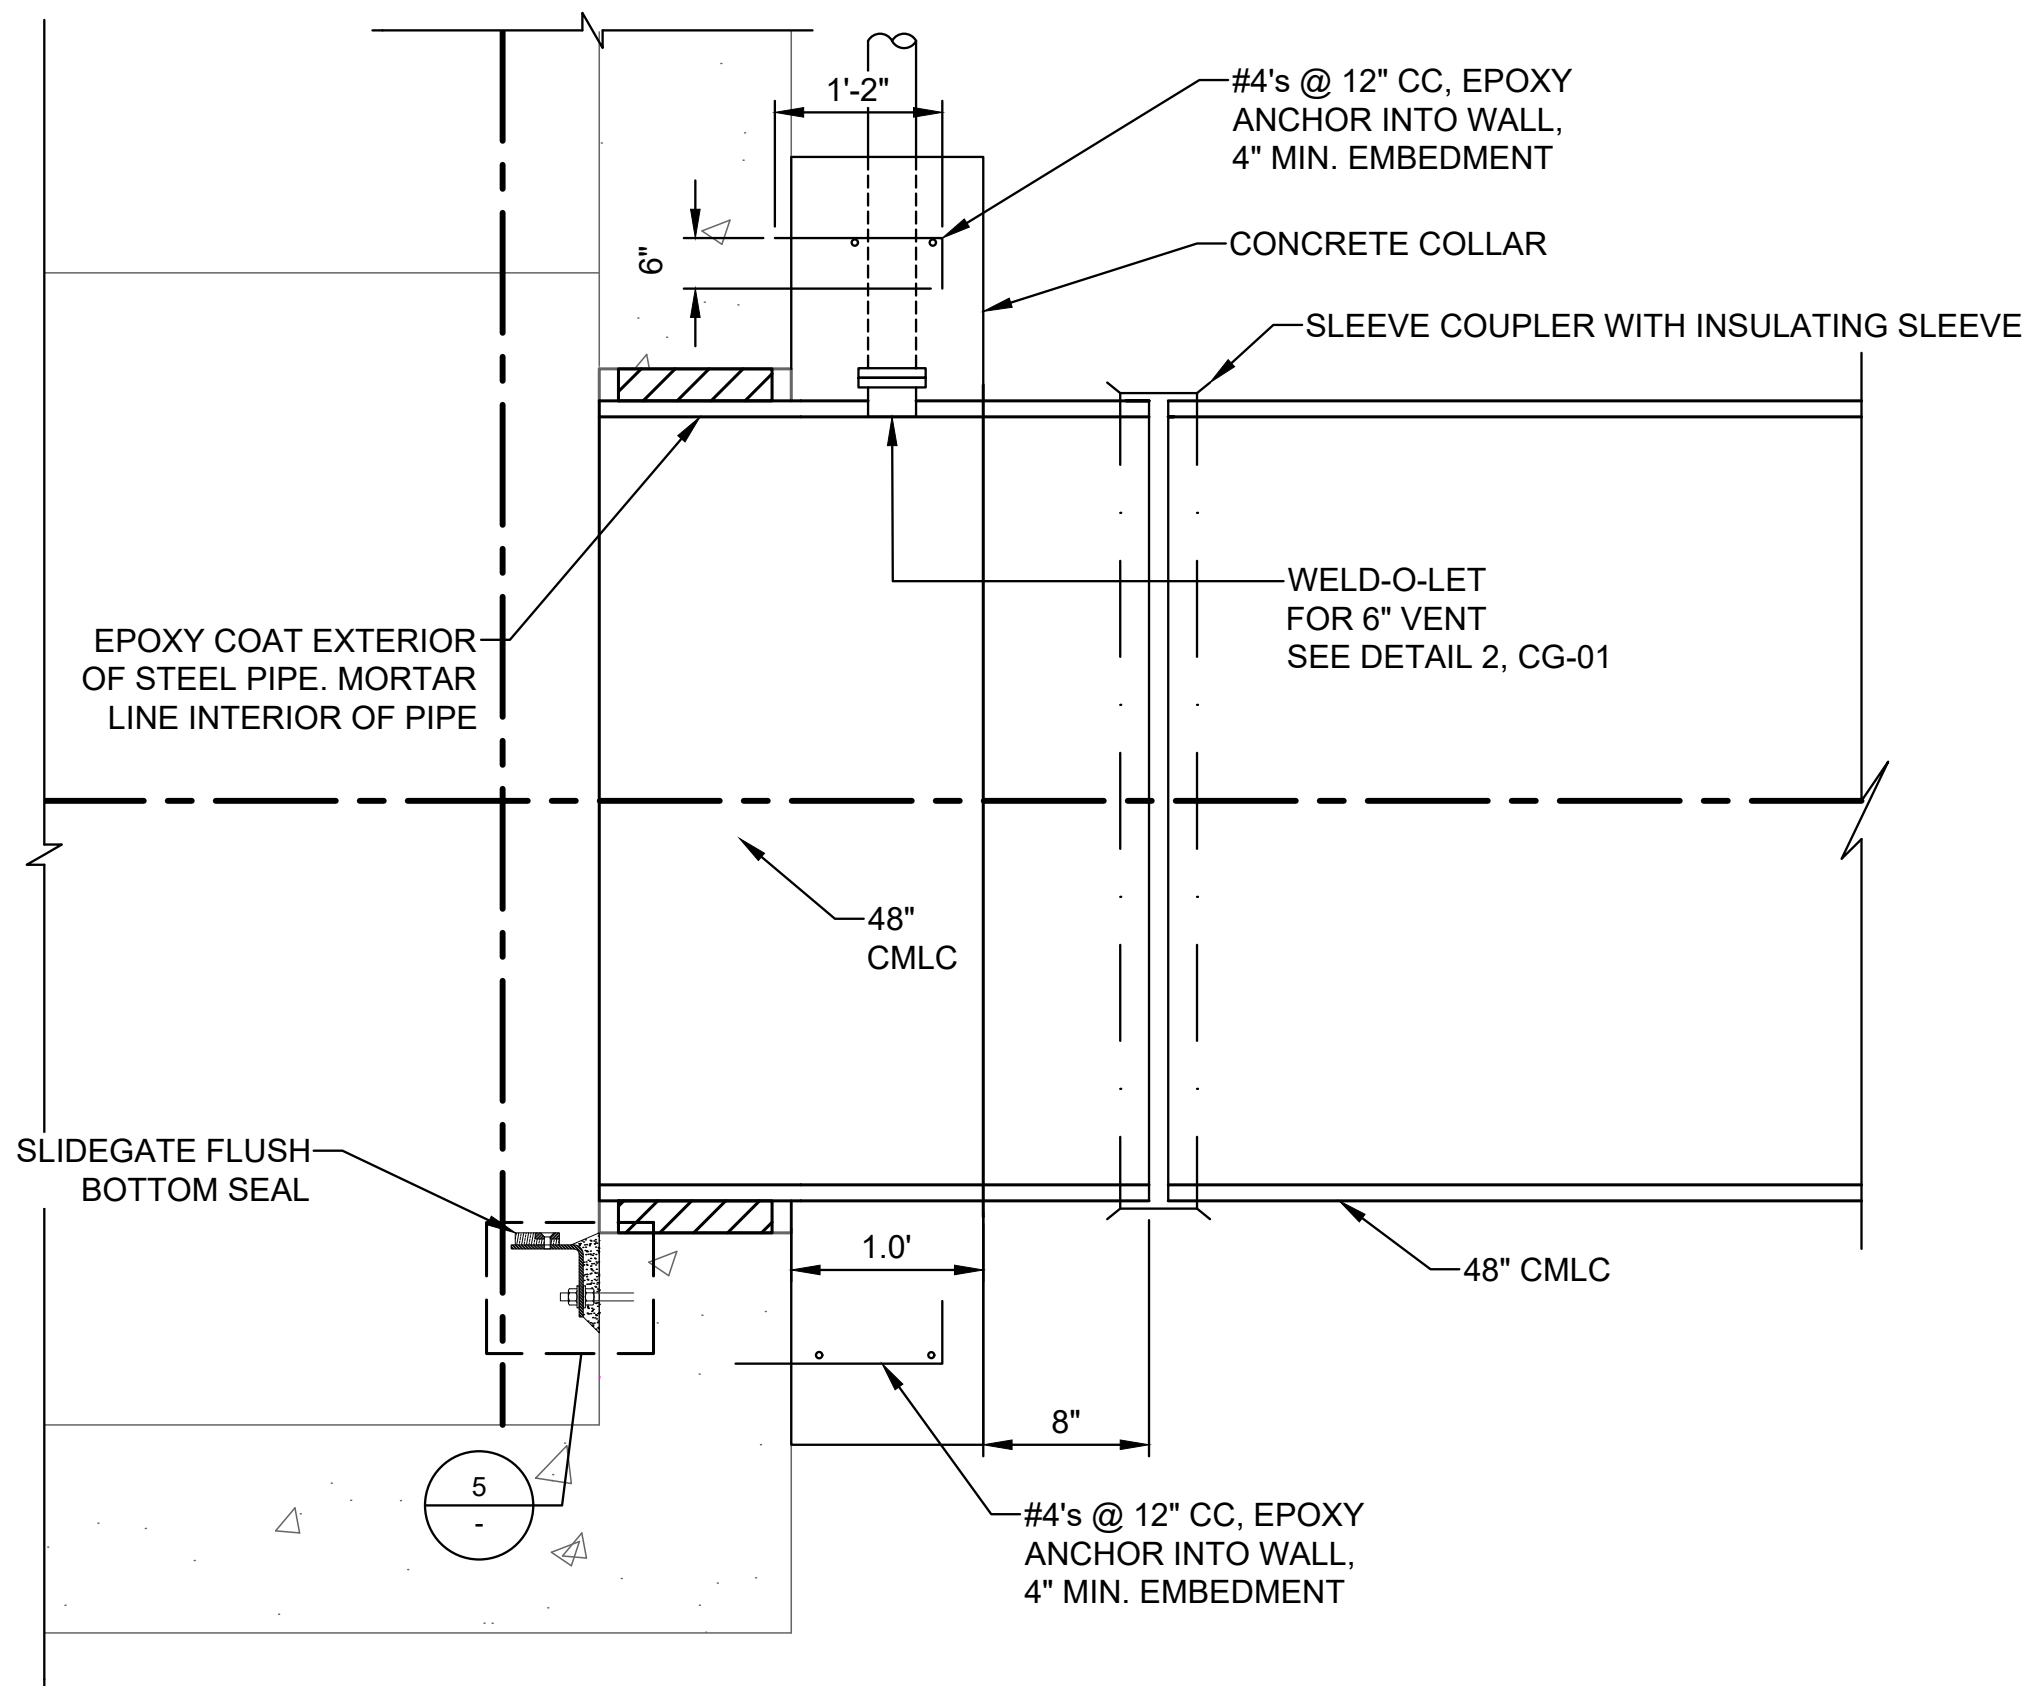


5 DETAIL
SLIDE GATE FLUSH BOTTOM SEAL NO SCALE

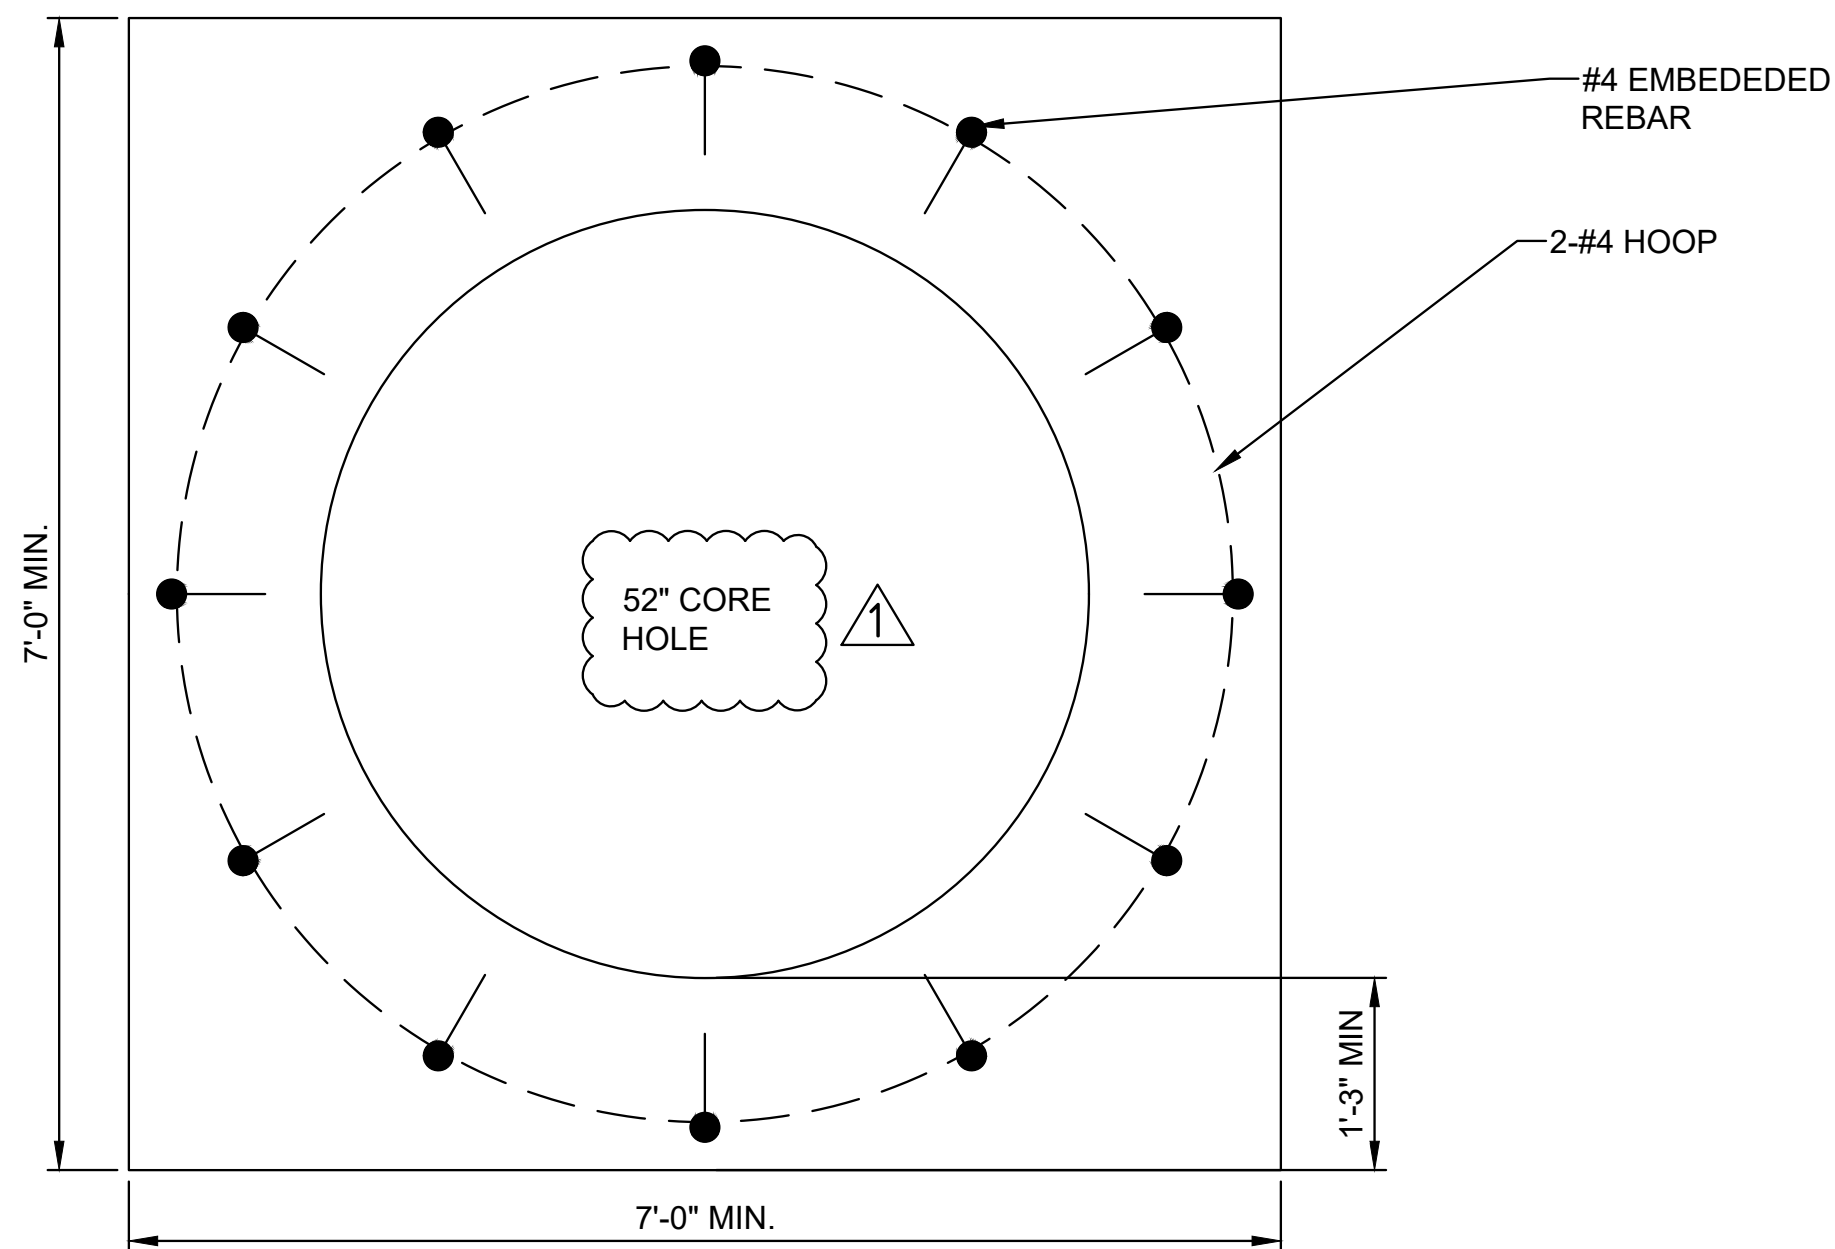

6 48" CMLC SEAL DETAIL
NO SCALE

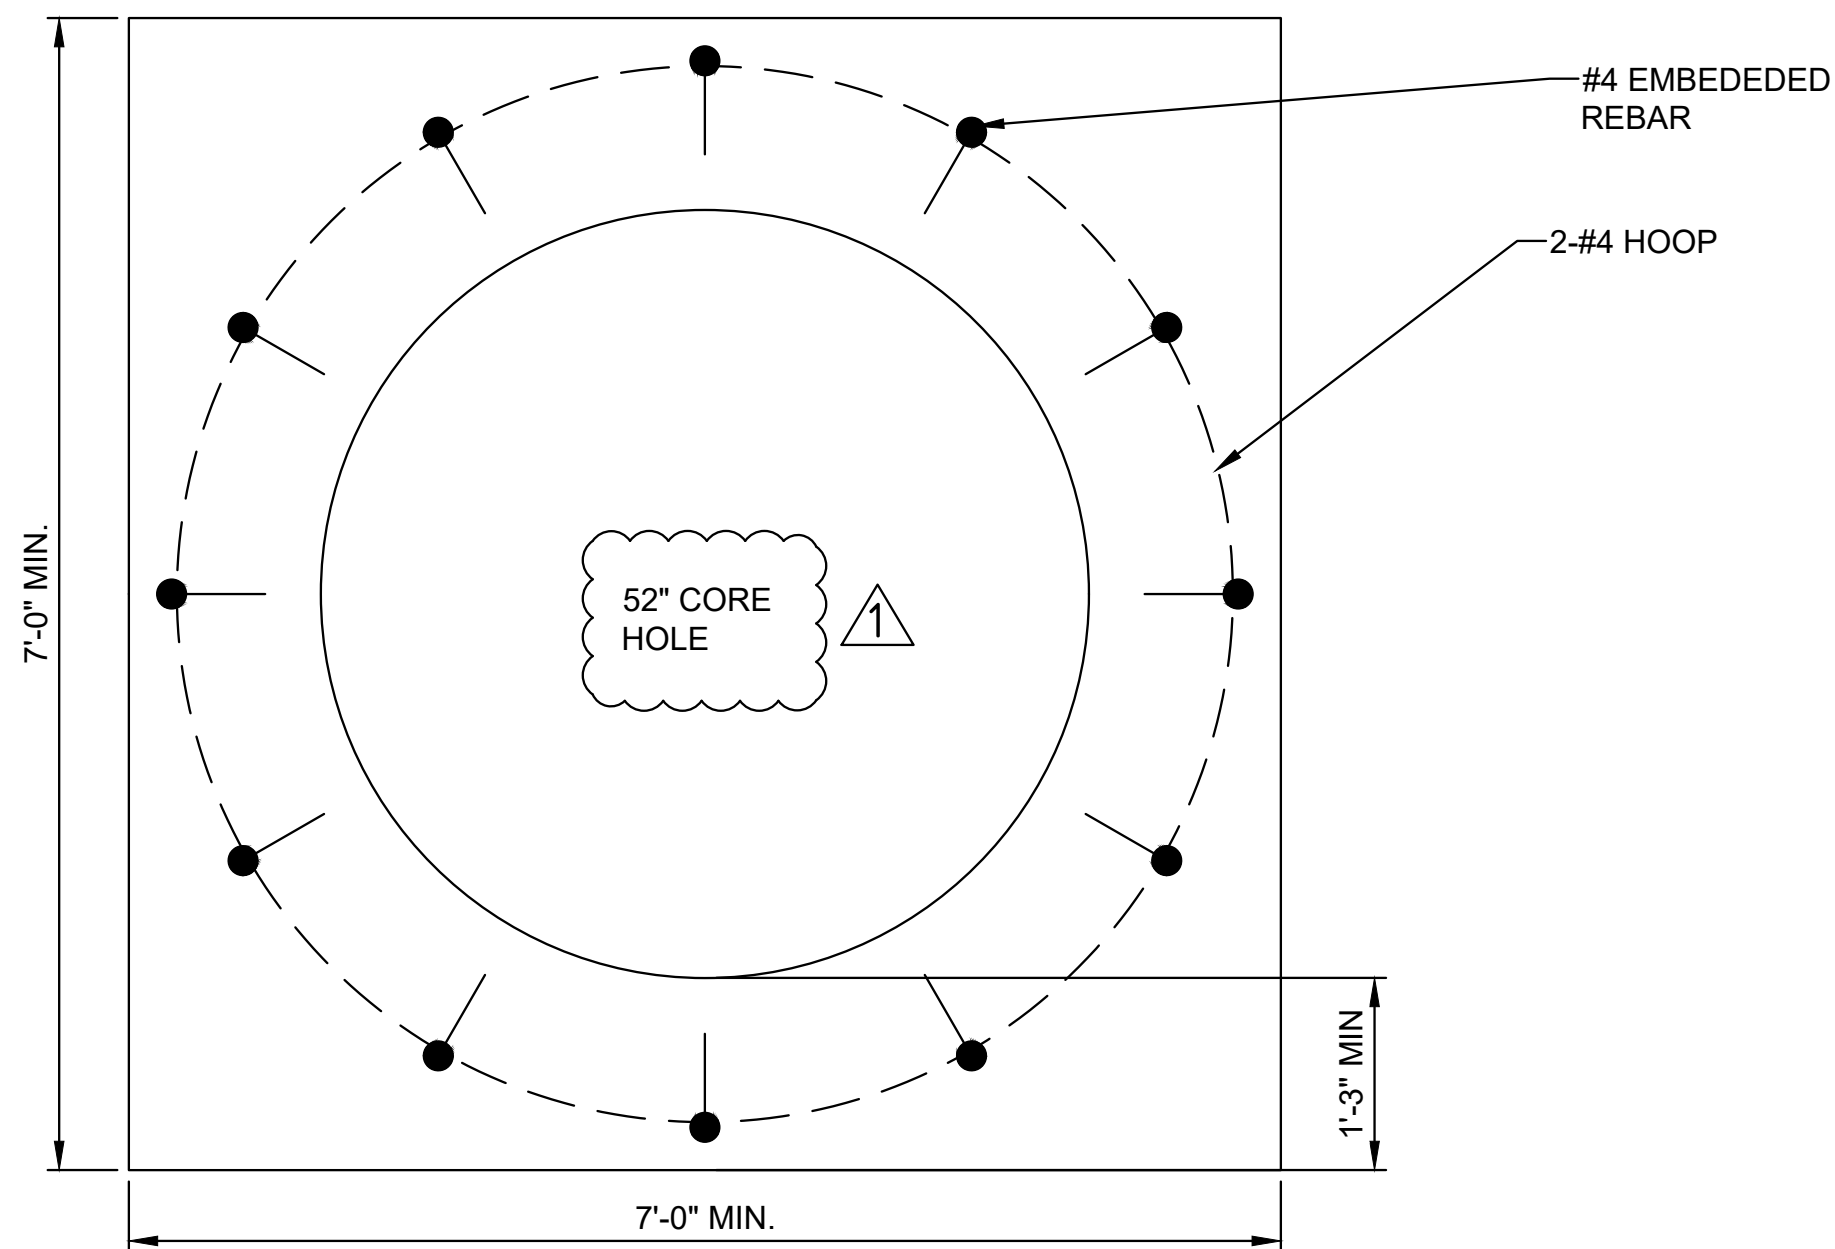

7 PROFILE CONCRETE COLLAR
NO SCALE

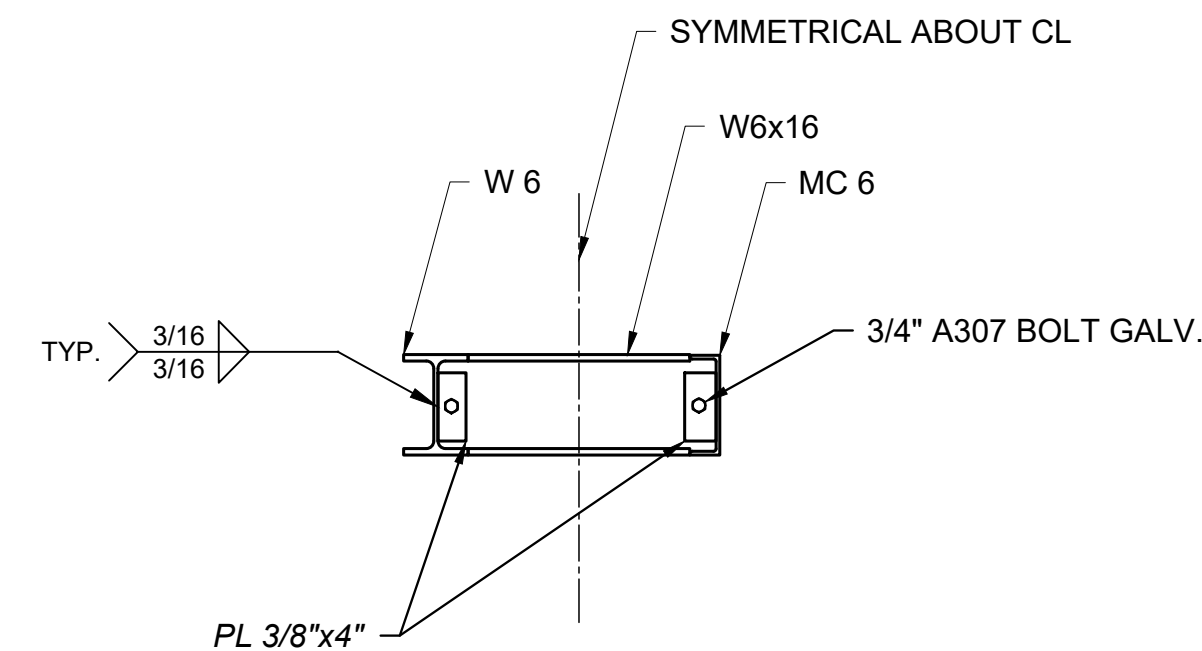

8 DETAIL
PEDESTAL SUPPORT CONNECTION NO SCALE

Attention:
0 1"
If this scale bar does not measure 1" then drawing is not original scale.

Designed: S. SCHAEFER
Drawn: F. ACUNA
Checked: M. MARTIN
Approved: S. SCHAEFER
P.E. No: 35079
GEI Project 2303615

GEI CONSULTANTS, INC.
5001 CALIFORNIA AVENUE
SUITE 120
BAKERSFIELD, CA 93309
(661)327-7601

SOUTHERN SAN JOAQUIN
MUNICIPAL UTILITY DISTRICT
11281 GARZOLI AVE
DELANO, CA 93215

GEI PROJECT 2303615

**SSJMUD 26-02
CARATAN RECHARGE
PIPELINE**

1	8/27/2026	ADDENDUM 1	MM
NO	DATE	ISSUE/REVISION	APP

SHEET NAME
**DIVERSION STRUCTURE
MODIFICATIONS AND
DETAILS 3 OF 3**

DWG NO.
C-08

SHEET. NO.
12 OF 17

IFB